



City of Houston - Department of Aviation – Infrastructure Division

PROJECT MANUAL

**METRO BUS DRIVE LANE RECONSTRUCTION
WILLIAM P. HOBBY AIRPORT (HOU)**

PROJECT No.: 236

TIP-20-101-HOU

VOLUME NO. 1 OF 1 TOTAL VOLUMES

TxDOT Specifications

June 2020

Atkins North America
200 Westlake Park Blvd., Suite 1100
Houston, TX 77079
(713) 576-8500



Edmond Woods, P.E.
06/26/2020

Item 104

Removing Concrete



1. DESCRIPTION

Break, remove, and salvage or dispose of existing hydraulic cement concrete.

2. CONSTRUCTION

Remove existing hydraulic cement concrete from locations shown on the plans. Avoid damaging concrete that will remain in place. Saw-cut and remove the existing concrete to neat lines. Replace any concrete damaged by the Contractor at no expense to the Department. Accept ownership and properly dispose of broken concrete in accordance with federal, state, and local regulations unless otherwise shown on the plans.

3. MEASUREMENT

Removing concrete pavement, floors, porches, patios, riprap, medians, foundations, sidewalks, driveways, and other appurtenances will be measured by the square yard (regardless of thickness) or by the cubic yard of calculated volume, in its original position.

Removing curb, curb and gutter, and concrete traffic barrier will be measured by the foot in its original position. The removal of monolithic concrete curb or doweled concrete curb will be included in the concrete pavement measurement.

Removing retaining walls will be measured by the square yard along the front face from the top of the wall to the top of the footing.

This is a plans quantity measurement Item. The quantity to be paid is the quantity shown in the proposal, unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

4. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Removing Concrete" of the type specified. This price is full compensation for breaking the concrete; loading, hauling, and salvaging or disposing of the material; and equipment, labor, tools, and incidentals.

Removing retaining wall footings will not be paid for directly but will be considered subsidiary to this Item.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 105

Removing Treated and Untreated Base and Asphalt Pavement



1. DESCRIPTION

Break, remove, and store or dispose of existing asphalt pavement, including surface treatments, and treated or untreated base materials.

2. CONSTRUCTION

Break material retained by the Department into pieces not larger than 24 in. unless otherwise shown on the plans. Remove existing asphalt pavement before disturbing stabilized base. Avoid contamination of the asphalt materials and damage to adjacent areas. Repair material damaged by operations outside the designated locations.

Stockpile materials designated salvageable at designated sites when shown on the plans or as directed. Prepare stockpile site by removing vegetation and trash and by providing for proper drainage. Material not designated to be salvaged will become the property of the Contractor. When this material is disposed of, do so in accordance with federal, state, and local regulations.

3. MEASUREMENT

This Item will be measured by the 100-ft. station along the baseline of each roadbed, by the square yard of existing treated or untreated base and asphalt pavement in its original position, or by the cubic yard of existing treated or untreated base and asphalt pavement in its original position, as calculated by the average end area method. Square yard and cubic yard measurement will be established by the widths and depths shown on the plans and the lengths measured in the field.

4. PAYMENT

The work performed in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Removing Treated and Untreated Base and Asphalt Pavement" of the depth specified. This price is full compensation for breaking the material, loading, hauling, unloading, stockpiling or disposing; repair to areas outside designated locations for removal; and equipment, labor, tools, and incidentals.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 260

Lime Treatment (Road-Mixed)



1. DESCRIPTION

Mix and compact lime, water, and subgrade or base (with or without asphaltic concrete pavement) in the roadway.

2. MATERIALS

Furnish uncontaminated materials of uniform quality that meet the requirements of the plans and specifications. Notify the Engineer of the proposed material sources and of changes to material sources. Obtain verification from the Engineer that the specification requirements are met before using the sources. The Engineer may sample and test project materials at any time before compaction. Use [Tex-100-E](#) for material definitions.

- 2.1. **Lime.** Furnish lime that meets the requirements of [DMS-6350](#), "Lime and Lime Slurry," and [DMS-6330](#), "Pre-Qualification of Lime Sources." Use hydrated lime, commercial lime slurry, quicklime, or carbide lime slurry as shown on the plans. Do not use quicklime when sulfates are present in quantities greater than 3,000 ppm. When furnishing quicklime, provide it in bulk.
- 2.2. **Subgrade.** The Engineer will determine the sulfate content of the existing subgrade in accordance with [Tex-145-E](#) and organic content in accordance with [Tex-148-E](#) before lime treatment begins. Suspend operations when material to be treated has a sulfate content greater than 7,000 ppm or an organic content greater than 1.0% and proceed as directed.
- 2.3. **Flexible Base.** Unless otherwise shown on the plans, furnish base material that meets the requirements of Item 247, "Flexible Base," for the type and grade shown on the plans, before the addition of lime.
- 2.4. **Water.** Furnish water free of industrial wastes and other objectionable material.
- 2.5. **Asphalt.** When asphalt or emulsion is permitted for curing purposes, furnish materials that meet the requirements of Item 300, "Asphalts, Oils, and Emulsions," as shown on the plans or as directed.
- 2.6. **Mix Design.** The Engineer will determine the target lime content and optimum moisture content in accordance with [Tex-121-E](#) or prior experience with the project materials. The Contractor may propose a mix design developed in accordance with [Tex-121-E](#). The Engineer will use [Tex-121-E](#) to verify the Contractor's proposed mix design before acceptance. Reimburse the Department for subsequent mix designs or partial designs necessitated by changes in the material or requests by the Contractor. Limit the amount of recycled asphalt pavement to no more than 50% of the mix unless otherwise shown on the plans or directed.

3. EQUIPMENT

Provide machinery, tools, and equipment necessary for proper execution of the work. Provide rollers in accordance with Item 210, "Rolling." Provide proof rollers in accordance with Item 216, "Proof Rolling," when required.

- 3.1. **Storage Facility.** Store quicklime and dry hydrated lime in closed, weatherproof containers.
- 3.2. **Slurry Equipment.** Use slurry tanks equipped with agitation devices to slurry hydrated lime or quicklime on the project or other approved location. The Engineer may approve other slurring methods.

- 3.3. Provide a pump for agitating the slurry when the distributor truck is not equipped with an agitator. Equip the distributor truck with a sampling device in accordance with [Tex-600-J](#), Part I, when using commercial lime slurry or carbide lime slurry.
- 3.4. **Hydrated Lime Distribution Equipment.** Provide equipment to spread lime evenly across the area to be treated. Provide equipment with a rotary vane feeder to spread lime, when shown on the plans.
- 3.5. **Pulverization Equipment.** Provide pulverization equipment that:
- cuts and pulverizes material uniformly to the proper depth with cutters that plane to a uniform surface over the entire width of the cut,
 - provides a visible indication of the depth of cut at all times, and
 - uniformly mixes the materials.

4. CONSTRUCTION

Construct each layer uniformly, free of loose or segregated areas, and with the required density and moisture content. Provide a smooth surface that conforms to the typical sections, lines, and grades shown on the plans or as directed.

- 4.1. **Preparation of Subgrade or Existing Base for Treatment.** Before treating, remove existing asphalt pavement in accordance with Item 105, "Removing Treated and Untreated Base and Asphalt Pavement," when shown on the plans or as directed. Shape existing material in accordance with applicable bid items to conform to typical sections shown on the plans and as directed.

Unless otherwise approved, proof roll the roadbed in accordance with Item 216, "Proof Rolling," before pulverizing or scarifying existing material. Correct soft spots as directed.

When material is imported from a borrow source, notify the Engineer of the location of the borrow source well in advance to allow time for testing and approval to avoid delay to the project. Stockpile as directed. The Engineer will test the borrow source and determine the sulfate and organic contents. When the borrow source has a sulfate content greater than 3,000 ppm or an organic content greater than 1.0%, proceed as directed.

When new base material is required to be mixed with existing base, deliver, place, and spread the new material in the required amount per station. Manipulate and thoroughly mix new base with existing material to provide a uniform mixture to the specified depth before shaping.

- 4.2. **Pulverization.** Pulverize or scarify existing material after shaping so that 100% passes a 2-1/2 in. sieve. If the material cannot be uniformly processed to the required depth in a single pass, excavate and windrow the material to expose a secondary grade to achieve processing to plan depth.

- 4.3. **Application of Lime.** Uniformly apply lime using dry or slurry placement as shown on the plans or as directed. Add lime at the percentage determined in Section 260.2.6., "Mix Design." Apply lime only on an area where mixing can be completed during the same working day.

Start lime application only when the air temperature is at least 35°F and rising or is at least 40°F. The temperature will be taken in the shade and away from artificial heat. Suspend application when the Engineer determines that weather conditions are unsuitable.

Minimize dust and scattering of lime by wind. Do not apply lime when wind conditions, in the opinion of the Engineer, cause blowing lime to become dangerous to traffic or objectionable to adjacent property owners. When pebble grade quicklime is placed dry, mix the material and lime thoroughly at the time of lime application. Use of quicklime can be dangerous. Inform users of the recommended precautions for handling and storage.

- 4.3.1. **Dry Placement.** Before applying lime, bring the prepared roadway to approximately 2 percentage points above optimum moisture content. When necessary, sprinkle in accordance with Item 204, "Sprinkling." Distribute the required quantity of hydrated lime or pebble grade quicklime with approved equipment. Only hydrated lime may be distributed by bag. Do not use a motor grader to spread hydrated lime.
- 4.3.2. **Slurry Placement.** Provide slurry free of objectionable materials, at or above the minimum dry solids content, and with a uniform consistency that will allow ease of handling and uniform application. Deliver commercial lime slurry or carbide lime slurry to the jobsite, or use hydrated lime or quicklime to prepare lime slurry at the jobsite or other approved location, as specified. When dry quicklime is applied as slurry, use 80% of the amount shown on the plans.
- Distribute slurry uniformly by making successive passes over a measured section of roadway until the specified lime content is reached. Uniformly spread the residue from quicklime slurry over the length of the roadway being processed, unless otherwise directed.
- 4.4. **Mixing.** Begin mixing within 6 hr. of application of lime. Hydrated lime exposed to the open air for 6 hr. or more between application and mixing, or that experiences excessive loss due to washing or blowing, will not be accepted for payment.

Thoroughly mix the material and lime using approved equipment. When treating subgrade, bring the moisture content above the optimum moisture content to insure adequate chemical reaction of the lime and subgrade materials. Allow the mixture to mellow for 1 to 4 days, as directed. When pebble grade quicklime is used, allow the mixture to mellow for 2 to 4 days, as directed. Sprinkle the treated materials during the mixing and mellowing operation, as directed, to achieve adequate hydration and proper moisture content. When the material to be treated has a sulfate content greater than 3,000 ppm but less than or equal to 7,000 ppm, mellow for a minimum of 7 days. Maintain in a continuously moist condition by sprinkling in accordance with Item 204, "Sprinkling." After mellowing, resume mixing until a homogeneous, friable mixture is obtained. After mixing, the Engineer may sample the mixture at roadway moisture and test in accordance with [Tex-101-E](#), Part III, to determine compliance with the gradation requirements in Table 1.

Table 1
Gradation Requirements (Minimum % Passing)

Sieve Size	Base	Subgrade
1-3/4"	100	100
3/4"	85	85
#4	–	60

- 4.5. **Compaction.** Compact the mixture using density control, unless otherwise shown on the plans. Multiple lifts are permitted when shown on the plans or approved. Bring each layer to the moisture content directed. Sprinkle the treated material in accordance with Item 204, "Sprinkling" or aerate the treated material to adjust the moisture content during compaction so that it is no more than 1.0 percentage points below optimum and 2.0 percentage points above optimum as determined by [Tex-121-E](#). Measure the moisture content of the material in accordance with [Tex-115-E](#) or [Tex-103-E](#) during compaction daily and report the results the same day, unless otherwise shown on the plans or directed.

Begin rolling longitudinally at the sides and proceed toward the center, overlapping on successive trips by at least 1/2 the width of the roller unit. On superelevated curves, begin rolling at the low side and progress toward the high side. Offset alternate trips of the roller. Operate rollers at a speed between 2 and 6 mph as directed.

Before final acceptance, the Engineer will select the locations of tests in each unit and measure the treated depth in accordance with [Tex-140-E](#). Correct areas deficient by more than 1/2 in. in thickness or more than 1/2% in target lime content by adding lime as required, reshaping, recompacting, and refinishing at the Contractor's expense.

Rework, recompact, and refinish material that fails to meet or that loses required moisture, density, stability, or finish before the next course is placed or the project is accepted. Continue work until specification

requirements are met. Rework in accordance with Section 260.4.6., "Reworking a Section." Perform the work at no additional expense to the Department.

- 4.5.1. **Ordinary Compaction.** Roll with approved compaction equipment, as directed. Correct irregularities, depressions, and weak spots immediately by scarifying the areas affected, adding or removing treated material as required, reshaping, and recompacting.
- 4.5.2. **Density Control.** The Engineer will determine roadway density and moisture content of completed sections in accordance with [Tex-115-E](#). The Engineer may accept the section if no more than 1 of the 5 most recent density tests is below the specified density and the failing test is no more than 3 pcf below the specified density.
- 4.5.2.1. **Subgrade.** Compact to at least 95% of the maximum density determined in accordance with [Tex-121-E](#), unless otherwise shown on the plans.
- 4.5.2.2. **Base.** Compact the bottom course to at least 95% of the maximum density determined in accordance with [Tex-121-E](#), unless otherwise shown on the plans. Compact subsequent courses treated under this Item to at least 98% of the maximum density determined in accordance with [Tex-121-E](#), unless otherwise shown on the plans.
- 4.6. **Reworking a Section.** When a section is reworked within 72 hr. after completion of compaction, rework the section to provide the required density. When a section is reworked more than 72 hr. after completion of compaction, add additional lime at 25% of the percentage determined in Section 260.2.6., "Mix Design." Reworking includes loosening, adding material or removing unacceptable material if necessary, mixing as directed, compacting, and finishing. When density control is specified, determine a new maximum density of the reworked material in accordance with [Tex-121-E](#), and compact to at least 95% of this density.
- 4.7. **Finishing.** Immediately after completing compaction of the final course, clip, skin, or tight-blade the surface of the lime-treated material with a maintainer or subgrade trimmer to a depth of approximately 1/4 in. Remove loosened material and dispose of at an approved location. Roll the clipped surface immediately with a pneumatic tire roller until a smooth surface is attained. Add small amounts of water as needed during rolling. Shape and maintain the course and surface in conformity with the typical sections, lines, and grades shown on the plans or as directed.
- Finish grade of constructed subgrade to within 0.1 ft. in the cross-section and 0.1 ft. in 16 ft. measured longitudinally.
- Correct grade deviations of constructed base greater than 1/4 in. in 16 ft. measured longitudinally or greater than 1/4 in. over the entire width of the cross-section in areas where surfacing is to be placed. Remove excess material, reshape, and roll with a pneumatic-tire roller. Correct as directed if material is more than 1/4 in. low. Do not surface patch. The 72-hr. time limit required for completion of placement, compaction, and finishing does not apply to finishing required just before applying the surface course.
- 4.8. **Curing.** Cure for the minimum number of days shown in Table 2 by sprinkling in accordance with Item 204, "Sprinkling," or by applying an asphalt material at a rate of 0.05 to 0.20 gal. per square yard as directed. Maintain moisture during curing. Upon completion of curing, maintain the moisture content in accordance with Section 132.3.5., "Maintenance of Moisture and Reworking," for subgrade and Section 247.4.5., "Curing" for bases before placing subsequent courses. Do not allow equipment on the finished course during curing except as required for sprinkling, unless otherwise approved. Apply seals or additional courses within 14 calendar days of final compaction.

Table 2
Minimum Curing Requirements before Placing Subsequent Courses¹

Untreated Material	Curing (Days)
PI ≤ 35	2
PI > 35	5

1. Subject to the approval of the Engineer. Proof rolling may be required as an indicator of adequate curing.

5. MEASUREMENT

- 5.1. **Lime.** When lime is furnished in trucks, the weight of lime will be determined on certified scales, or the Contractor must provide a set of standard platform truck scales at a location approved by the Engineer. Scales must conform to the requirements of Item 520, "Weighing and Measuring Equipment."

When lime is furnished in bags, indicate the manufacturer's certified weight. Bags varying more than 5% from that weight may be rejected. The average weight of bags in any shipment, as determined by weighing 10 bags taken at random, must be at least the manufacturer's certified weight.

5.1.1. Hydrated Lime.

- 5.1.1.1. **Dry.** Lime will be measured by the ton (dry weight).

- 5.1.1.2. **Slurry.** Lime slurry will be measured by the ton (dry weight) of the hydrated lime used to prepare the slurry at the jobsite.

- 5.1.2. **Commercial Lime Slurry.** Lime slurry will be measured by the ton (dry weight) as calculated from the minimum percent dry solids content of the slurry, multiplied by the weight of the slurry in tons delivered.

5.1.3. Quicklime.

- 5.1.3.1. **Dry.** Lime will be measured by the ton (dry weight) of the quicklime.

- 5.1.3.2. **Slurry.** Lime slurry will be measured by the ton (dry weight) of the quicklime used to prepare the slurry multiplied by a conversion factor of 1.28 to give the quantity of equivalent hydrated lime, which will be the basis of payment.

- 5.1.4. **Carbide Lime Slurry.** Lime slurry will be measured by the ton (dry weight) as calculated from the minimum percent dry solids content of the slurry, multiplied by the weight of the slurry in tons delivered.

- 5.2. **Lime Treatment.** Lime treatment will be measured by the square yard of surface area. The dimensions for determining the surface area are established by the widths shown on the plans and the lengths measured at placement.

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid in accordance with Section 260.6.1., "Lime," and Section 260.6.2., "Lime Treatment."

Furnishing and delivering new base will be paid for in accordance with Section 247.6.2., "Flexible Base (Roadway Delivery)." Mixing, spreading, blading, shaping, compacting, and finishing new or existing base material will be paid for in accordance with Section 260.6.2., "Lime Treatment." Removal and disposal of existing asphalt concrete pavement will be paid for in accordance with pertinent Items or Article 4.4., "Changes in the Work."

Sprinkling and rolling, except proof rolling, will not be paid for directly but will be subsidiary to this Item, unless otherwise shown on the plans. When proof rolling is shown on the plans or directed by the Engineer, it will be paid for in accordance with Item 216, "Proof Rolling."

Where subgrade is constructed under this Contract, correction of soft spots in the subgrade or existing base will be at the Contractor's expense. Where subgrade is not constructed under this Contract, correction of soft spots in the subgrade or existing base will be paid for in accordance with pertinent Items or Article 4.4., "Changes in the Work."

Where subgrade to be treated under this Contract has sulfates greater than 7,000 ppm, work will be paid for in accordance with Article 4.4., "Changes in the Work."

Asphalt used solely for curing will not be paid for directly but will be subsidiary to this Item. Asphalt placed for curing and priming will be paid for under Item 310, "Prime Coat."

6.1. **Lime.** Lime will be paid for at the unit price bid for "Lime" of one of the following types:

- Hydrated Lime (Dry),
- Hydrated Lime (Slurry),
- Commercial Lime Slurry,
- Quicklime (Dry),
- Quicklime (Slurry), or
- Carbide Lime Slurry.

This price is full compensation for materials, delivery, equipment, labor, tools, and incidentals.

Lime used for reworking a section in accordance with Section 260.4.6., "Reworking a Section," will not be paid for directly but will be subsidiary to this Item.

6.2. **Lime Treatment.** Lime treatment will be paid for at the unit price bid for "Lime Treatment (Existing Material)," "Lime Treatment (New Base)," or "Lime Treatment (Mixing Existing Material and New Base)," for the depth specified. No payment will be made for thickness or width exceeding that shown on the plans. This price is full compensation for shaping existing material, loosening, mixing, pulverizing, spreading, applying lime, compacting, finishing, curing, curing materials, blading, shaping and maintaining shape, replacing mixture, disposing of loosened materials, processing, hauling, preparing secondary subgrade, water, equipment, labor, tools, and incidentals.

Item 360

Concrete Pavement



1. DESCRIPTION

Construct hydraulic cement concrete pavement with or without curbs on the concrete pavement.

2. MATERIALS

- 2.1. **Hydraulic Cement Concrete.** Provide hydraulic cement concrete in accordance with Item 421, "Hydraulic Cement Concrete." Use compressive strength testing unless otherwise shown on the plans. Provide Class P concrete designed to meet a minimum average compressive strength of 3,200 psi or a minimum average flexural strength of 450 psi at 7 days or a minimum average compressive strength of 4,000 psi or a minimum average flexural strength of 570 psi at 28 days. Test in accordance with [Tex-448-A](#) or [Tex-418-A](#).

Obtain written approval if the concrete mix design exceeds 520 lb. per cubic yard of cementitious material.

Use coarse aggregates for continuously reinforced concrete pavements to produce concrete with a coefficient of thermal expansion not more than 5.5×10^{-6} in./in./°F. Provide satisfactory [Tex-428-A](#) test data from an approved testing laboratory if the coarse aggregate coefficient of thermal expansion listed on the Department's *Concrete Rated Source Quality Catalog* is not equal to or less than 5.5×10^{-6} in./in./°F.

Provide Class HES concrete for very early opening of small pavement areas or leave-outs to traffic when shown on the plans or allowed. Design Class HES to meet the requirements of Class P and a minimum average compressive strength of 3,200 psi or a minimum average flexural strength of 450 psi in 24 hr., unless other early strength and time requirements are shown on the plans or allowed.

Use Class A or P concrete meeting the requirements of Item 421, "Hydraulic Cement Concrete," and this Item for curbs that are placed separately from the pavement.

- 2.2. **Reinforcing Steel.** Provide Grade 60 or above, deformed steel for bar reinforcement in accordance with Item 440, "Reinforcement for Concrete." Provide positioning and supporting devices (baskets and chairs) capable of securing and holding the reinforcing steel in proper position before and during paving. Provide corrosion protection when shown on the plans.
- 2.2.1. **Dowels.** Provide smooth, straight dowels of the size shown on the plans, free of burrs, and conforming to the requirements of Item 440, "Reinforcement for Concrete." Coat dowels with a thin film of grease, wax, silicone or other approved de-bonding material. Provide dowel caps on the lubricated end of each dowel bar used in an expansion joint. Provide dowel caps filled with a soft compressible material with enough range of movement to allow complete closure of the expansion joint.
- 2.2.2. **Tie Bars.** Provide straight deformed steel tie bars. Provide either multiple-piece tie bars or single-piece tie bars as shown on the plans. Furnish multiple piece tie bar assemblies from the list of approved multiple-piece tie bars that have been prequalified in accordance with DMS-4515, "Multiple Piece Tie Bars for Concrete Pavements," when used. Multiple-piece tie bars used on individual projects must be sampled in accordance with [Tex-711-I](#), and tested in accordance with DMS-4515 "Multiple Piece Tie Bars for Concrete Pavements."
- 2.3. **Alternative Reinforcing Materials.** Provide reinforcement materials of the dimensions and with the physical properties specified when allowed or required by the plans. Provide manufacturer's certification of required material properties.

- 2.4. **Curing Materials.** Provide Type 2 membrane curing compound conforming to [DMS-4650](#), "Hydraulic Cement Concrete Curing Materials and Evaporation Retardants." Provide SS-1 emulsified asphalt conforming to Item 300, "Asphalts, Oils, and Emulsions," for concrete pavement to be overlaid with asphalt concrete under this Contract unless otherwise shown on the plans or approved. Provide materials for other methods of curing conforming to the requirements of Item 422, "Concrete Superstructures." Provide insulating blankets for curing fast track concrete pavement with a minimum thermal resistance (R) rating of 0.5 hour-square foot F/BTU. Use insulating blankets that are free from tears and are in good condition.
- 2.5. **Epoxy.** Provide Type III, Class C epoxy in accordance with [DMS-6100](#), "Epoxies and Adhesives," for installing all drilled-in reinforcing steel. Submit a work plan and request approval for the use of epoxy types other than Type III, Class C.
- 2.6. **Evaporation Retardant.** Provide evaporation retardant conforming to [DMS-4650](#), "Hydraulic Cement Concrete Curing Materials and Evaporation Retardants."
- 2.7. **Joint Sealants and Fillers.** Provide Class 5 or Class 8 joint-sealant materials and fillers unless otherwise shown on the plans or approved and other sealant materials of the size, shape, and type shown on the plans in accordance with [DMS-6310](#), "Joint Sealants and Fillers."

3. EQUIPMENT

Furnish and maintain all equipment in good working condition. Use measuring, mixing, and delivery equipment conforming to the requirements of Item 421, "Hydraulic Cement Concrete." Obtain approval for other equipment used.

- 3.1. **Placing, Consolidating, and Finishing Equipment.** Provide approved self-propelled paving equipment that uniformly distributes the concrete with minimal segregation and provides a smooth machine-finished consolidated concrete pavement conforming to plan line and grade. Provide an approved automatic grade control system on slip-forming equipment. Provide approved mechanically-operated finishing floats capable of producing a uniformly smooth pavement surface. Provide equipment capable of providing a fine, light water fog mist.

When string-less paving equipment is used, use Section 5.9.3, "Method C," and establish control points at maximum intervals of 500 ft. Use these control points as reference to perform the work.

Provide mechanically-operated vibratory equipment capable of adequately consolidating the concrete. Provide immersion vibrators on the paving equipment at sufficiently close intervals to provide uniform vibration and consolidation of the concrete over the entire width and depth of the pavement and in accordance with the manufacturer's recommendations. Provide immersion vibrator units that operate at a frequency in air of at least 8,000 cycles per minute. Provide enough hand-operated immersion vibrators for timely and proper consolidation of the concrete along forms, at all joints and in areas not covered by other vibratory equipment. Surface vibrators may be used to supplement equipment-mounted immersion vibrators. Provide tachometers to verify the proper operation of all vibrators.

For small or irregular areas or when approved, the paving equipment described in this Section is not required.

- 3.2. **Forming Equipment.**
- 3.2.1. **Pavement Forms.** Provide metal side forms of sufficient cross-section, strength, and rigidity to support the paving equipment and resist the impact and vibration of the operation without visible springing or settlement. Use forms that are free from detrimental kinks, bends, or warps that could affect ride quality or alignment. Provide flexible or curved metal or wood forms for curves of 100-ft. radius or less.
- 3.2.2. **Curb Forms.** Provide curb forms for separately placed curbs that are not slipformed that conform to the requirements of Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter."

- 3.3. **Reinforcing Steel Inserting Equipment.** Provide inserting equipment that accurately inserts and positions reinforcing steel in the plastic concrete parallel to the profile grade and horizontal alignment in accordance to plan details when approved.
- 3.4. **Texturing Equipment.**
- 3.4.1. **Carpet Drag.** Provide a carpet drag mounted on a work bridge or a manual moveable support system. Provide a single piece of carpet of sufficient transverse length to span the full width of the pavement being placed and adjustable so that a sufficient longitudinal length of carpet is in contact with the concrete being placed to produce the desired texture. Obtain approval to vary the length and width of the carpet to accommodate specific applications.
- 3.4.2. **Tining Equipment.** Provide a self-propelled metal tine device equipped with steel tines with cross-section approximately 1/32 in. thick × 1/12 in. wide. Provide tines for transverse tining equipment spaced at approximately 1 in., center-to-center, or provide tines for longitudinal tining equipment spaced at approximately 3/4 in., center-to-center. Manual methods that produce an equivalent texture may be used when it is impractical to use self-propelled equipment, such as for small areas, narrow width sections, and in emergencies due to equipment breakdown.
- 3.5. **Curing Equipment.** Provide a self-propelled machine for applying membrane curing compound using mechanically-pressurized spraying equipment with atomizing nozzles. Provide equipment and controls that maintain the required uniform rate of application over the entire paving area. Provide curing equipment that is independent of all other equipment when required to meet the requirements of Section 360.4.9., "Curing." Hand-operated pressurized spraying equipment with atomizing nozzles may only be used on small or irregular areas, narrow width sections, or in emergencies due to equipment breakdown.
- 3.6. **Sawing Equipment.** Provide power-driven concrete saws to saw the joints shown on the plans. Provide standby power-driven concrete saws during concrete sawing operations.
- 3.7. **Grinding Equipment.** Provide self-propelled powered grinding equipment that is specifically designed to smooth and texture concrete pavement using circular diamond blades when required. Provide equipment with automatic grade control capable of grinding at least a 3-ft. width longitudinally in each pass without damaging the concrete.
- 3.8. **Testing Equipment.** Provide testing equipment regardless of job-control testing responsibilities in accordance with Item 421, "Hydraulic Cement Concrete," unless otherwise shown on the plans or specified.
- 3.9. **Coring Equipment.** Provide coring equipment capable of extracting cores in accordance with the requirements of [Tex-424-A](#) when required.
- 3.10. **Miscellaneous Equipment.** Furnish both 10-ft. and 15-ft. steel or magnesium long-handled, standard straightedges. Furnish enough work bridges, long enough to span the pavement, for finishing and inspection operations.

4. CONSTRUCTION

Obtain approval for adjustments to plan grade-line to maintain thickness over minor subgrade or base high spots while maintaining clearances and drainage. Maintain subgrade or base in a smooth, clean, compacted condition in conformity with the required section and established grade until the pavement concrete is placed. Keep subgrade or base damp with water before placing pavement concrete.

Adequately light the active work areas for all nighttime operations. Provide and maintain tools and materials to perform testing.

- 4.1. **Paving and Quality Control Plan.** Submit a paving and quality control plan for approval before beginning pavement construction operations. Include details of all operations in the concrete paving process, including

methods to construct transverse joints, methods to consolidate concrete at joints, longitudinal construction joint layout, sequencing, curing, lighting, early opening, leave-outs, sawing, inspection, testing, construction methods, other details and description of all equipment. List certified personnel performing the testing. Submit revisions to the paving and quality control plan for approval.

- 4.2. **Job-Control Testing.** Perform all fresh and hardened concrete job-control testing at the specified frequency unless otherwise shown on the plans. Provide job-control testing personnel meeting the requirements of Item 421, "Hydraulic Cement Concrete." Provide and maintain testing equipment, including strength testing equipment at a location acceptable to the Engineer. Use of a commercial laboratory is acceptable. Maintain all testing equipment calibrated in accordance with pertinent test methods. Make strength-testing equipment available to the Engineer for verification testing.

Provide the Engineer the opportunity to witness all tests. The Engineer may require a retest if not given the opportunity to witness. Furnish a copy of all test results to the Engineer daily. Check the first few concrete loads for slump and temperature to verify concrete conformance and consistency on start-up production days. Sample and prepare strength-test specimens (2 specimens per test) on the first day of production and for each 3,000 sq. yd. or fraction thereof of concrete pavement thereafter. Prepare at least 1 set of strength-test specimens for each production day. Perform slump and temperature tests each time strength specimens are made. Monitor concrete temperature to ensure that concrete is consistently within the temperature requirements. The Engineer will direct random job-control sampling and testing. Immediately investigate and take corrective action as approved if any Contractor test result, including tests performed for verification purposes, does not meet specification requirements.

The Engineer will perform job-control testing when the testing by the Contractor is waived by the plans; however, this does not waive the Contractor's responsibility for providing materials and work in accordance with this Item.

- 4.2.1. **Job-Control Strength.** Use 7-day job-control concrete strength testing in accordance with [Tex-448-A](#) or [Tex-418-A](#) unless otherwise shown on the plans or permitted.

Use a compressive strength of 3,200 psi or a lower job-control strength value proven to meet a 28-day compressive strength of 4,000 psi as correlated in accordance with [Tex-427-A](#) for 7-day job-control by compressive strength. Use a flexural strength of 450 psi or a lower job-control strength value proven to meet a 28-day flexural strength of 570 psi as correlated in accordance with [Tex-427-A](#) for 7-day job-control by flexural strength.

Job control of concrete strength may be correlated to an age other than 7 days in accordance with [Tex-427-A](#) when approved. Job-control strength of Class HES concrete is based on the required strength and time.

Investigate the strength test procedures, the quality of materials, the concrete production operations, and other possible problem areas to determine the cause when a job-control concrete strength test value is more than 10% below the required job-control strength or when 3 consecutive job-control strength values fall below the required job-control strength. Take necessary action to correct the problem, including redesign of the concrete mix if needed. The Engineer may suspend concrete paving if the Contractor is unable to identify, document, and correct the cause of low-strength test values in a timely manner. The Engineer will evaluate the structural adequacy of the pavements if any job-control strength is more than 15% below the required job-control strength. Remove and replace pavements found to be structurally inadequate at no additional cost when directed.

- 4.2.2. **Split-Sample Verification Testing.** Perform split-sample verification testing with the Engineer on random samples taken and split by the Engineer at a rate of at least 1 for every 10 job-control samples. The Engineer will evaluate the results of split-sample verification testing. Immediately investigate and take corrective action as approved when results of split-sample verification testing differ more than the allowable differences shown in Table 1, or the average of 10 job-control strength results and the Engineer's split-sample strength result differ by more than 10%.

**Table 1
Verification Testing Limits**

Test Method	Allowable Differences
Temperature, Tex-422-A	2°F
Flexural strength, Tex-448-A	19%
Compressive strength, Tex-418-A	10%

- 4.3. **Reinforcing Steel and Joint Assemblies.** Accurately place and secure in position all reinforcing steel as shown on the plans. Place dowels at mid-depth of the pavement slab, parallel to the surface. Place dowels for transverse contraction joints parallel to the pavement edge. Tolerances for location and alignment of dowels will be shown on the plans. Stagger the lap locations so that no more than 1/3 of the longitudinal steel is spliced in any given 12-ft. width and 2-ft. length of the pavement. Use multiple-piece tie bars, drill and epoxy grout tie bars, or, if approved, mechanically-inserted single-piece tie bars at longitudinal construction joints. Verify that tie bars that are drilled and epoxied or mechanically inserted into concrete at longitudinal construction joints develop a pullout resistance equal to a minimum of 3/4 of the yield strength of the steel after 7 days. Test 15 bars using ASTM E488, except that alternate approved equipment may be used. All 15 tested bars must meet the required pullout strength. Perform corrective measures to provide equivalent pullout resistance if any of the test results do not meet the required minimum pullout strength. Repair damage from testing. Acceptable corrective measures include but are not limited to installation of additional or longer tie bars.
- 4.3.1. **Manual Placement.** Secure reinforcing bars at alternate intersections with wire ties or locking support chairs. Tie all splices with wire.
- 4.3.2. **Mechanical Placement.** Complete the work using manual placement methods described above if mechanical placement of reinforcement results in steel misalignment or improper location, poor concrete consolidation, or other inadequacies.
- 4.4. **Joints.** Install joints as shown on the plans. Joint sealants are not required on concrete pavement that is to be overlaid with asphaltic materials. Clean and seal joints in accordance with Item 438, "Cleaning and Sealing Joints." Repair excessive spalling of the joint saw groove using an approved method before installing the sealant. Seal all joints before opening the pavement to all traffic. Install a rigid transverse bulkhead, for the reinforcing steel, and shaped accurately to the cross-section of the pavement when placing of concrete is stopped.
- 4.4.1. **Placing Reinforcement at Joints.** Complete and place the assembly of parts at pavement joints at the required location and elevation, with all parts rigidly secured in the required position, when shown on the plans.
- 4.4.2. **Transverse Construction Joints.**
- 4.4.2.1. **Continuously Reinforced Concrete Pavement (CRCP).** Install additional longitudinal reinforcement through the bulkhead when shown on the plans. Protect the reinforcing steel immediately beyond the construction joint from damage, vibration, and impact.
- 4.4.2.2. **Concrete Pavement Contraction Design (CPCD).** Install and rigidly secure a complete joint assembly and bulkhead in the planned transverse contraction joint location when the placing of concrete is intentionally stopped. Install a transverse construction joint either at a planned transverse contraction joint location or mid-slab between planned transverse contraction joints when the placing of concrete is unintentionally stopped. Install tie bars of the size and spacing used in the longitudinal joints for mid-slab construction joints.
- 4.4.2.3. **Curb Joints.** Provide joints in the curb of the same type and location as the adjacent pavement. Use expansion joint material of the same thickness, type, and quality required for the pavement and of the section shown for the curb. Extend expansion joints through the curb. Construct curb joints at all transverse pavement joints. Place reinforcing steel into the plastic concrete pavement for non-monolithic curbs as shown on the plans unless otherwise approved. Form or saw the weakened plane joint across the full width

of concrete pavement and through the monolithic curbs. Construct curb joints in accordance with Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter."

- 4.5. **Placing and Removing Forms.** Use clean and oiled forms. Secure forms on a base or firm subgrade that is accurately graded and that provides stable support without deflection and movement by form riding equipment. Pin every form at least at the middle and near each end. Tightly join and key form sections together to prevent relative displacement.

Set side forms far enough in advance of concrete placement to permit inspection. Check conformity of the grade, alignment, and stability of forms immediately before placing concrete, and make all necessary corrections. Use a straightedge or other approved method to test the top of forms to ensure that the ride quality requirements for the completed pavement will be met. Stop paving operations if forms settle or deflect more than 1/8 in. under finishing operations. Reset forms to line and grade, and refinish the concrete surface to correct grade.

Avoid damage to the edge of the pavement when removing forms. Repair damage resulting from form removal and honeycombed areas with a mortar mix within 24 hr. after form removal unless otherwise approved. Clean joint face and repair honeycombed or damaged areas within 24 hr. after a bulkhead for a transverse construction joint has been removed unless otherwise approved. Promptly apply membrane curing compound to the edge of the concrete pavement when forms are removed before 72 hr. after concrete placement.

Forms that are not the same depth as the pavement, but are within 2 in. of that depth are permitted if the subbase is trenched or the full width and length of the form base is supported with a firm material to produce the required pavement thickness. Promptly repair the form trench after use. Use flexible or curved wood or metal forms for curves of 100-ft. radius or less.

- 4.6. **Concrete Delivery.** Clean delivery equipment as necessary to prevent accumulation of old concrete before loading fresh concrete. Use agitated delivery equipment for concrete designed to have a slump of more than 5 in. Segregated concrete is subject to rejection.

Begin the discharge of concrete delivered in agitated delivery equipment conforming to the requirements of Item 421, "Hydraulic Cement Concrete." Place non-agitated concrete within 45 min. after batching. Reduce times as directed when hot weather or other conditions cause quick setting of the concrete.

- 4.7. **Concrete Placement.** Do not allow the pavement edge to deviate from the established paving line by more than 1/2 in. at any point. Place the concrete as near as possible to its final location, and minimize segregation and rehandling. Distribute concrete using shovels where hand spreading is necessary. Do not use rakes or vibrators to distribute concrete.

- 4.7.1. **Consolidation.** Consolidate all concrete by approved mechanical vibrators operated on the front of the paving equipment. Use immersion-type vibrators that simultaneously consolidate the full width of the placement when machine finishing. Keep vibrators from dislodging reinforcement. Use hand-operated vibrators to consolidate concrete along forms, at all joints and in areas not accessible to the machine-mounted vibrators. Do not operate machine-mounted vibrators while the paving equipment is stationary. Vibrator operations are subject to review.

- 4.7.2. **Curbs.** Conform to the requirements of Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter" where curbs are placed separately.

- 4.7.3. **Temperature Restrictions.** Place concrete that is between 40°F and 95°F when measured in accordance with [Tex-422-A](#) at the time of discharge, except that concrete may be used if it was already in transit when the temperature was found to exceed the allowable maximum. Take immediate corrective action or cease concrete production when the concrete temperature exceeds 95°F.

Do not place concrete when the ambient temperature in the shade is below 40°F and falling unless approved. Concrete may be placed when the ambient temperature in the shade is above 35°F and rising or

above 40°F. Protect the pavement with an approved insulating material capable of protecting the concrete for the specified curing period when temperatures warrant protection against freezing. Submit for approval proposed measures to protect the concrete from anticipated freezing weather for the first 72 hr. after placement. Repair or replace all concrete damaged by freezing.

- 4.8. **Spreading and Finishing.** Finish all concrete pavement with approved self-propelled equipment. Use power-driven spreaders, power-driven vibrators, power-driven strike-off, screed, or approved alternate equipment. Use the transverse finishing equipment to compact and strike-off the concrete to the required section and grade without surface voids. Use float equipment for final finishing. Use concrete with a consistency that allows completion of all finishing operations without addition of water to the surface. Use the minimal amount of water fog mist necessary to maintain a moist surface. Reduce fogging if float or straightedge operations result in excess slurry.
- 4.8.1. **Finished Surface.** Perform sufficient checks with long-handled 10-ft. and 15-ft. straightedges on the plastic concrete to ensure the final surface is within the tolerances specified in Surface Test A in Item 585, "Ride Quality for Pavement Surfaces." Check with the straightedge parallel to the centerline.
- 4.8.2. **Maintenance of Surface Moisture.** Prevent surface drying of the pavement before application of the curing system by means that may include water fogging, the use of wind screens, and the use of evaporation retardants. Apply evaporation retardant at the manufacturer's recommended rate. Reapply the evaporation retardant as needed to maintain the concrete surface in a moist condition until curing system is applied. Do not use evaporation retardant as a finishing aid. Failure to take acceptable precautions to prevent surface drying of the pavement will be cause for shutdown of pavement operations.
- 4.8.3. **Surface Texturing.** Complete final texturing before the concrete has attained its initial set. Drag the carpet longitudinally along the pavement surface with the carpet contact surface area adjusted to provide a satisfactory coarsely textured surface. Prevent the carpet from getting plugged with grout. Do not perform carpet dragging operations while there is excessive bleed water.
- A metal-tine texture finish is required unless otherwise shown on the plans. Provide transverse tining unless otherwise shown on the plans. Immediately following the carpet drag, apply a single coat of evaporation retardant, if needed, at the rate recommended by the manufacturer. Provide the metal-tine finish immediately after the concrete surface has set enough for consistent tining. Operate the metal-tine device to obtain grooves approximately 3/16 in. deep, with a minimum depth of 1/8 in., and approximately 1/12 in. wide. Do not overlap a previously tined area. Use manual methods to achieve similar results on ramps, small or irregular areas, and narrow width sections of pavements. Repair damage to the edge of the slab and joints immediately after texturing. Do not tine pavement that will be overlaid or that is scheduled for blanket diamond grinding or shot blasting.
- Target a carpet drag texture of 0.04 in., as measured by [Tex-436-A](#), when carpet drag is the only surface texture required on the plans. Ensure adequate and consistent macro-texture is achieved by applying enough weight to the carpet and by keeping the carpet from getting plugged with grout. Correct any location with a texture less than 0.03 in. by diamond grinding or shot blasting. The Engineer will determine the test locations at points located transversely to the direction of traffic in the outside wheel path.
- 4.8.4. **Small, Irregular Area, or Narrow Width Placements.** Use hand equipment and procedures that produce a consolidated and finished pavement section to the line and grade where machine placements and finishing of concrete pavement are not practical.
- 4.8.5. **Emergency Procedures.** Use hand-operated equipment for applying texture, evaporation retardant, and cure in the event of equipment breakdown.
- 4.9. **Curing.** Keep the concrete pavement surface from drying as described in Section 360.4.8.2., "Maintenance of Surface Moisture," until the curing material has been applied. Maintain and promptly repair damage to curing materials on exposed surfaces of concrete pavement continuously for at least 3 curing days. A curing day is defined as a 24-hr. period when either the temperature taken in the shade away from artificial heat is above 50°F for at least 19 hr. or the surface temperature of the concrete is maintained above 40°F for 24 hr.

Curing begins when the concrete curing system has been applied. Stop concrete paving if curing compound is not being applied promptly and maintained adequately. Other methods of curing in accordance with Item 422, "Concrete Superstructures," may be used when specified or approved.

- 4.9.1. **Membrane Curing.** Spray the concrete surface uniformly with 2 coats of membrane curing compound at an individual application rate of no more than 180 sq. ft. per gallon. Apply the curing compound before allowing the concrete surface to dry.

Manage finishing and texturing operations to ensure placement of curing compound on a moist concrete surface, relatively free of bleed water, to prevent any plastic shrinkage cracking. Time the application of curing compound to prevent plastic shrinkage cracking.

Maintain curing compounds in a uniformly agitated condition, free of settlement before and during application. Do not thin or dilute the curing compound.

Apply additional compound at the same rate of coverage to correct damage where the coating shows discontinuities or other defects or if rain falls on the newly coated surface before the film has dried enough to resist damage. Ensure that the curing compound coats the sides of the tining grooves.

- 4.9.2. **Asphalt Curing.** Apply a uniform coating of asphalt curing at a rate of 90 to 180 sq. ft. per gallon when an asphaltic concrete overlay is required. Apply curing immediately after texturing and once the free moisture (sheen) has disappeared. Obtain approval to add water to the emulsion to improve spray distribution. Maintain the asphalt application rate when using diluted emulsions. Maintain the emulsion in a mixed condition during application.

- 4.9.3. **Curing Class HES Concrete.** Provide membrane curing in accordance with Section 360.4.9.1., "Membrane Curing," for all Class HES concrete pavement. Promptly follow by wet mat curing in accordance with Section 422.4.8., "Final Curing," until opening strength is achieved but not less than 24 hr.

- 4.9.4. **Curing Fast-Track Concrete Pavement.** Provide wet mat curing unless otherwise shown on the plans or as directed. Cure in accordance with Section 422.4.8., "Final Curing." Apply a Type 1-D or Type 2 membrane cure instead of wet mat curing if the air temperature is below 65°F and insulating blankets are used.

- 4.10. **Sawing Joints.** Saw joints to the depth shown on the plans as soon as sawing can be accomplished without damage to the pavement regardless of time of day or weather conditions. Some minor raveling of the saw-cut is acceptable. Use a chalk line, string line, sawing template, or other approved method to provide a true joint alignment. Provide enough saws to match the paving production rate to ensure sawing completion at the earliest possible time to avoid uncontrolled cracking. Reduce paving production if necessary to ensure timely sawing of joints. Promptly restore membrane cure damaged within the first 72 hr. of curing.

- 4.11. **Protection of Pavement and Opening to Traffic.** Testing for early opening is the responsibility of the Contractor regardless of job-control testing responsibilities unless otherwise shown on the plans or as directed. Testing result interpretation for opening to traffic is subject to approval.

- 4.11.1. **Protection of Pavement.** Erect and maintain barricades and other standard and approved devices that will exclude all vehicles and equipment from the newly placed pavement for the periods specified. Protect the pavement from damage due to crossings using approved methods before opening to traffic. Where a detour is not readily available or economically feasible, an occasional crossing of the roadway with overweight equipment may be permitted for relocating equipment only but not for hauling material. When an occasional crossing of overweight equipment is permitted, temporary matting or other approved methods may be required.

Maintain an adequate supply of sheeting or other material to cover and protect fresh concrete surface from weather damage. Apply as needed to protect the pavement surface from weather.

- 4.11.2. **Opening Pavement to All Traffic.** Pavement that is 7 days old may be opened to all traffic. Clean pavement, place stable material against the pavement edges, seal joints, and perform all other traffic safety related work before opening to traffic.
- 4.11.3. **Opening Pavement to Construction Equipment.** Unless otherwise shown on the plans, concrete pavement may be opened early to concrete paving equipment and related delivery equipment after the concrete is at least 48 hr. old and opening strength has been demonstrated in accordance with Section 360.4.11.4., “Early Opening to All Traffic,” before curing is complete. Keep delivery equipment at least 2 ft. from the edge of the concrete pavement. Keep tracks of the paving equipment at least 1 ft. from the pavement edge. Protect textured surfaces from the paving equipment. Restore damaged membrane curing as soon as possible. Repair pavement damaged by paving or delivery equipment before opening to all traffic.
- 4.11.4. **Early Opening to All Traffic.** Concrete pavement may be opened after curing is complete and the concrete has attained a flexural strength of 450 psi or a compressive strength of 3,200 psi, except that pavement using Class HES concrete may be opened after 24 hr. if the specified strength is achieved.
- 4.11.4.1. **Strength Testing.** Test concrete specimens cured under the same conditions as the portion of the pavement involved.
- 4.11.4.2. **Maturity Method.** Use the maturity method, [Tex-426-A](#), to estimate concrete strength for early opening pavement to traffic unless otherwise shown on the plans. Install at least 2 maturity sensors for each day’s placement in areas where the maturity method will be used for early opening. Maturity sensors, when used, will be installed near the day’s final placement for areas being evaluated for early opening. Use test specimens to verify the strength–maturity relationship in accordance with [Tex-426-A](#), starting with the first day’s placement corresponding to the early opening pavement section.
- Verify the strength–maturity relationship at least every 10 days of production after the first day. Establish a new strength–maturity relationship when the strength specimens deviate more than 10% from the maturity-estimated strengths. Suspend use of the maturity method for opening pavements to traffic when the strength–maturity relationship deviates by more than 10% until a new strength–maturity relationship is established.
- The Engineer will determine the frequency of verification when the maturity method is used intermittently or for only specific areas.
- 4.11.5. **Fast Track Concrete Pavement.** Open the pavement after the concrete has been cured for at least 8 hr. and attained a minimum compressive strength of 1,800 psi or a minimum flexural strength of 255 psi when tested in accordance with Section 360.4.11.4.1., “Strength Testing,” or Section 360.4.11.4.2., “Maturity Method,” unless otherwise directed. Cover the pavement with insulating blankets when the air temperature is below 65°F until the pavement is opened to traffic.
- 4.11.6. **Emergency Opening to Traffic.** Open the pavement to traffic under emergency conditions, when the pavement is at least 72 hr. old when directed in writing. Remove all obstructing materials, place stable material against the pavement edges, and perform other work involved in providing for the safety of traffic as required for emergency opening.
- 4.12. **Pavement Thickness.** The Engineer will check the thickness in accordance with [Tex-423-A](#) unless other methods are shown on the plans. The Engineer will perform 1 thickness test consisting of 1 reading at approximately the center of the paving equipment every 500 ft. or fraction thereof. Core where directed, in accordance with [Tex-424-A](#), to verify deficiencies of more than 0.2 in. from plan thickness and to determine the limits of deficiencies of more than 0.75 in. from plan thickness. Fill core holes using an approved concrete mixture and method.
- 4.12.1. **Thickness Deficiencies Greater than 0.2 in.** Take one 4-in. diameter core at that location to verify the measurement when any depth test measured in accordance with [Tex-423-A](#) is deficient by more than 0.2 in. from the plan thickness.

Take 2 additional cores from the unit (as defined in Section 360.4.12.3., "Pavement Units for Payment Adjustment" at intervals of at least 150 ft. and at selected locations if the core is deficient by more than 0.2 in., but not by more than 0.75 in. from the plan thickness, and determine the thickness of the unit for payment purposes by averaging the length of the 3 cores. In calculations of the average thickness of this unit of pavement, measurements in excess of the specified thickness by more than 0.2 in. will be considered as the specified thickness plus 0.2 in.

4.12.2. **Thickness Deficiencies Greater than 0.75 in.** Take additional cores at 10-ft. intervals in each direction parallel to the centerline to determine the boundary of the deficient area if a core is deficient by more than 0.75 in. The Engineer will evaluate any area of pavement found deficient in thickness by more than 0.75 in., but not more than 1 in. Remove and replace the deficient areas without additional compensation or retain deficient areas without compensation, as directed. Remove and replace any area of pavement found deficient in thickness by more than 1 in. without additional compensation.

4.12.3. **Pavement Units for Payment Adjustment.** Limits for applying a payment adjustment for deficient pavement thickness from 0.20 in. to not more than 0.75 in. are 500 ft. of pavement in each lane. Lane width will be as shown on typical sections and pavement design standards.

For greater than 0.75 in. deficient thickness, the limits for applying zero payment or requiring removal will be defined by coring or equivalent nondestructive means as determined by the Engineer. The remaining portion of the unit determined to be less than 0.75 in. deficient will be subject to the payment adjustment based on the average core thickness at each end of the 10-ft. interval investigation as determined by the Engineer.

Shoulders will be measured for thickness unless otherwise shown on the plans. Shoulders 6 ft. wide or wider will be considered as lanes. Shoulders less than 6 ft. wide will be considered part of the adjacent lane.

Limits for applying payment adjustment for deficient pavement thickness for ramps, widenings, acceleration and deceleration lanes, and other miscellaneous areas are 500 ft. in length. Areas less than 500 ft. in length will be individually evaluated for payment adjustment based on the plan area.

4.13. **Ride Quality.** Measure ride quality in accordance with Item 585, "Ride Quality for Pavement Surfaces," unless otherwise shown on the plans.

5. MEASUREMENT

This Item will be measured as follows:

5.1. **Concrete Pavement.** Concrete pavement will be measured by the square yard of surface area in place. The surface area includes the portion of the pavement slab extending beneath the curb.

5.2. **Curb.** Curb on concrete pavement will be measured by the foot in place.

6. PAYMENT

These prices are full compensation for materials, equipment, labor, tools, and incidentals.

6.1. **Concrete Pavement.** The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the adjusted unit price bid for "Concrete Pavement" of the type and depth specified as adjusted in accordance with Section 360.6.2., "Deficient Thickness Adjustment."

6.2. **Deficient Thickness Adjustment.** Where the average thickness of pavement is deficient in thickness by more than 0.2 in. but not more than 0.75 in., payment will be made using the adjustment factor as specified in Table 2 applied to the bid price for the deficient area for each unit as defined under Section 360.4.12.3., "Pavement Units for Payment Adjustment."

Table 2
Deficient Thickness Price Adjustment Factor

Deficiency in Thickness Determined by Cores (in.)	Proportional Part of Contract Price Allowed (Adjustment Factor)
Not deficient	1.00
Over 0.00 through 0.20	1.00
Over 0.20 through 0.30	0.80
Over 0.30 through 0.40	0.72
Over 0.40 through 0.50	0.68
Over 0.50 through 0.75	0.57

- 6.3. **Curb.** Work performed and furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Curb" of the type specified.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 361

Repair of Concrete Pavement



1. DESCRIPTION

Repair concrete pavement to half-depth or full-depth in accordance with the details shown on the plans and the requirements of this Item.

2. MATERIALS

Furnish materials in accordance with the following:

- Item 360, "Concrete Pavement,"
- Item 421, "Hydraulic Cement Concrete,"
- Item 440, "Reinforcement for Concrete,"
- [DMS-6100](#), "Epoxyes and Adhesives," and
- [DMS-4655](#), "Concrete Repair Materials."

- 2.1. **Half-Depth Repair.** Obtain approval for the repair material mix design. The selection of repair material should be based on the time for opening to traffic and temperature range during the repair.

Provide Class HES concrete in accordance with Item 421, "Hydraulic Cement Concrete," and designed to attain a minimum average flexural strength of 255 psi or a minimum average compressive strength of 1,800 psi within the timeframe designated for opening to traffic if it is less than 72 hr. after concrete placement. Otherwise, provide Class S conforming to Item 421, "Hydraulic Cement Concrete" or Class P concrete conforming to Item 360, "Concrete Pavement."

Provide material meeting the requirements of [DMS-4655](#), "Concrete Repair Materials," Type A when Class HES concrete does not meet the strength requirement within the designated timeframe.

- 2.2. **Full-Depth Repair.** Obtain approval for the repair material mix design. The selection of repair material should be based on the time for opening to traffic and temperature range during the repair.

- 2.2.1. **Hydraulic Cement Concrete for Pavement.** Provide Class HES concrete designed to attain a minimum average flexural strength of 255 psi or a minimum average compressive strength of 1,800 psi within the designated timeframe if the timeframe designated for opening to traffic is less than 72 hr. after concrete placement. Otherwise, provide Class P concrete conforming to Item 360, "Concrete Pavement."

- 2.2.2. **Base Material.** Furnish cold-mix asphaltic materials for replacement base material when shown on the plans. The Engineer may waive quality control (QC) tests for base material.

- 2.2.3. **Asphalt Concrete.** Furnish asphalt concrete material for overlay and asphalt shoulder repair as shown on the plans. The Engineer may waive QC tests for this material.

3. EQUIPMENT

Provide tools and equipment necessary for proper execution of the work that meet the pertinent requirements of the following:

- Item 360, "Concrete Pavement"
- **Concrete Demolition Equipment.** Provide chipping hammers or hydro-demolition equipment for the bulk removal of concrete.

- **Concrete Lift-Out Equipment.** Provide steel chains, lift pins, and a crane or front-end loader capable of lifting the concrete and loading it onto a flatbed or dump truck.
- **Drill.** Use a maximum 40-lb. drill with tungsten carbide bits.
- **Air Compressor.** Provide compressor equipped with filters designed to remove oil from the air and capable of delivering air to remove dust and debris.

4. CONSTRUCTION

Submit for approval all materials and methods of application at least 2 weeks before beginning any repair work. Repair locations will be as indicated on the plans or as directed. Repair areas may be adjusted after removing distressed concrete. Switch the half-depth repair to the full-repair if exposed existing longitudinal bars are deficient, as approved. Compensation will be made for unexpected volumes of repair areas or changes in scope of work.

- 4.1. **Half-Depth Repair.** Repair locations will be as indicated on the plans or as directed. Repair boundaries should be square or rectangular with a minimum length and width of 12 in.

Saw-cut repair boundaries to a minimum depth of 1-1/2 in. Do not saw-cut longitudinal or transverse steel. If the longitudinal steel is cut, a full-depth repair may be required as directed without additional compensation.

Remove concrete from the repair area as designated. Start at the center of the repair area. Ensure all loose concrete materials are removed and only sound concrete is left in place. Increase the repair area and perform a full-depth repair as directed if longitudinal steel bars were damaged by the removal operations. No additional compensation will be made.

Clean the area to be repaired by approved methods. Remove all loose particles, dirt, deteriorated concrete, or other substances that would impair the bond of the repair material.

Mix, place, and cure in accordance with the manufacturer's recommendation when material in [DMS-4655](#), "Concrete Repair Materials," is used. Mix, place, and cure concrete in accordance with Item 360, "Concrete Pavement," when Class S, Class P, or Class HES is used. Test Class S, Class P, and Class HES concrete to the requirements of Section 360.4.2., "Job-Control Testing."

Match the grade and alignment of existing concrete pavement unless otherwise shown on the plans. Concrete pavement may be opened to traffic when specified strength is achieved.

- 4.2. **Full-Depth Repair.** Repair areas identified by the Engineer. Make repair areas rectangular, at least 6 ft. long and at least 1/2 a full lane in width unless otherwise shown on the plans. Accept ownership of all removed material, and dispose of it in accordance with federal, state, and local regulations unless otherwise shown on the plans. Saw-cut and remove existing asphalt concrete overlay at least 2 ft. longer than the repair patch in each longitudinal direction when there is existing asphalt concrete overlay over the repair area.

Saw-cut the full depth through the concrete around the perimeter of the repair area before removal. Schedule work so that concrete placement follows full-depth saw-cutting by no more than 7 days unless otherwise shown on the plans or approved.

Remove the slab by lifting the slab with a minimum disturbance to the base materials and surrounding concrete. Do not spall or fracture concrete adjacent to the repair area. Saw-cut and remove additional concrete as directed, after slab removal, if distresses are found in the surrounding concrete pavement. Repair damages to concrete pavement caused by the Contractor's operation without additional compensation. Perform repairs as directed.

Remove loose or damaged base material completely, leaving no loose base material.

Recompact base materials to the satisfaction of the Engineer. Level the base layer with cold-mix asphalt to the original bottom line and grade of the concrete slab before repair concrete is placed when shown on the plans. Place concrete directly onto the compacted base layer unless otherwise directed.

Use tie bars to restore the continuity of the concrete pavement. Demonstrate, through simulated job conditions, that the bond strength of the epoxy-grouted tie bars meets a pullout strength of at least 3/4 of the yield strength of the tie bar when tested in accordance with ASTM E488 within the epoxy manufacturer's recommended curing time. Increase embedment depth and retest when necessary to meet testing requirements. Perform tie bar testing before starting repair work.

Place tie bars as shown on the plans. Drill holes into the existing concrete at least 10 in. deep unless otherwise directed. Use a drill bit with a diameter that is 1/8 in. greater than that of tie bars. Clean the holes with a wire brush and compressed air to remove all the dust and moisture. Follow the epoxy manufacturer's instructions to apply the epoxy. Insert the tip of the epoxy cartridge or the tip of the machine applicator to the end of the tie bar hole, and inject Type III, Class C epoxy to fill the entire hole. Insert tie bars.

Place new deformed reinforcing steel bars of the same size and spacing as shown on the plans for Continuously Reinforced Concrete Pavement (CRCP) repairs. Lap all longitudinal reinforcing steel at least 25 in. Provide and place approved supports to firmly hold the new reinforcing steel in place when needed.

Place dowel bars as shown on the plans for Concrete Pavement Contraction Design (CPCD) repairs. Provide and place approved supports to firmly hold the dowel bars in place.

Mix, place, cure, and test concrete to the requirements of Item 360, "Concrete Pavement," and Item 421, "Hydraulic Cement Concrete." Broom-finish the concrete surface unless otherwise shown on the plans.

Perform a timely saw-cut over the dowel bars and restore the transverse contraction joint for CPCD. Restore the existing longitudinal joints to the requirements of Section 360.4.4., "Joints."

Match the grade and alignment of existing concrete pavement. Replace any asphalt overlay and shoulder material removed with new asphalt concrete material after concrete strength requirements have been met.

Remove repair area debris from the right of way each day. Concrete pavement may be opened to traffic when specified strength is achieved.

5. MEASUREMENT

This Item will be measured by the square yard in place of the completed concrete surface area repaired.

6. PAYMENT

The work performed and the materials furnished in accordance with this Item and measured as specified under "Measurement" will be paid for at the unit price bids for "Repair of Concrete Pavement (Half-Depth)" and "Repair of Concrete Pavement (Full-Depth)." This price is full compensation for removal, stockpiling, and disposal of waste material and for equipment, materials, labor, tools, and incidentals. Asphalt concrete, base material, and curbing will not be paid for directly but will be considered subsidiary to this Item.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 440

Reinforcement for Concrete



1. DESCRIPTION

Furnish and place reinforcement of the type, size, and details shown on the plans.

2. MATERIALS

Use deformed steel bar reinforcement unless otherwise specified or allowed.

- 2.1. **Approved Mills.** Before furnishing steel, producing mills of reinforcing steel for the Department must be pre-approved in accordance with [DMS-7320](#), "Qualification Procedure for Reinforcing Steel Producing Mills," by the Construction Division. The Department's MPL has a list of approved producing mills. Reinforcing steel obtained from unapproved sources will not be accepted.

Contact the Construction Division with the name and location of the producing mill for stainless reinforcing steel, low carbon/chromium reinforcing steel, or dual-coated reinforcing steel at least 4 weeks before ordering any material.

- 2.2. **Deformed Steel Bar Reinforcement.** Provide deformed reinforcing steel conforming to one of the following:

- ASTM A615, Grades 60, 75, or 80;
- ASTM A996, Type A, Grade 60;
- ASTM A996, Type R, Grade 60, permitted in concrete pavement only (Furnish ASTM A996, Type R bars as straight bars only and do not bend them. Bend tests are not required.); or
- ASTM A706, Grades 60 or 80.

Provide the grade of reinforcing steel shown on the plans. Provide Grade 60 if no grade is shown.

The nominal size, area, and weight of reinforcing steel bars this Item covers are shown in Table 1.

Table 1
Size, Area, and Weight of Reinforcing Steel Bars

Bar Size Number (in.)	Diameter (in.)	Area (sq. in.)	Weight per Foot (lbs.)
3	0.375	0.11	0.376
4	0.500	0.20	0.668
5	0.625	0.31	1.043
6	0.750	0.44	1.502
7	0.875	0.60	2.044
8	1.000	0.79	2.670
9	1.128	1.00	3.400
10	1.270	1.27	4.303
11	1.410	1.56	5.313
14	1.693	2.25	7.650
18	2.257	4.00	13.60

- 2.3. **Smooth Steel Bar Reinforcement.** Provide smooth bars for concrete pavement with a yield strength of at least 60 ksi and meeting ASTM A615. Provide steel conforming to ASTM A615 or meet the physical requirements of ASTM A36 for smooth bars that are larger than No. 3. Designate smooth bars by size number up to No. 4 and by diameter in inches above No. 4.

- 2.4. **Spiral Reinforcement.** Provide bars or wire for spiral reinforcement of the grade and minimum size or gauge shown on the plans.

Provide smooth or deformed wire conforming to ASTM A1064. Provide bars conforming to ASTM A615; ASTM A996, Type A; or ASTM A675, Grade 80, meeting dimensional requirements of ASTM A615.

- 2.5. **Weldable Reinforcing Steel.** Provide reinforcing steel conforming to ASTM A706 or with a maximum carbon equivalent (C.E.) of 0.55% if welding of reinforcing steel is required or desired. Provide a report showing the percentages of elements necessary to establish C.E. for reinforcing steel that does not meet ASTM A706, in order to be structurally welded. These requirements do not pertain to miscellaneous welds on reinforcing steel as defined in Section 448.4.2.1.1., "Miscellaneous Welding Applications."

Calculate C.E. using the following formula:

$$C.E. = \%C + \frac{\%Mn}{6} + \frac{\%Cu}{40} + \frac{\%Ni}{20} + \frac{\%Cr}{10} - \frac{\%Mo}{50} - \frac{\%V}{10}$$

Do not weld stainless reinforcing steel without permission from the Engineer. Provide stainless reinforcing steel suitable for welding, if required, and submit welding procedures and electrodes to the Engineer for approval.

- 2.6. **Welded Wire Reinforcement.** Provide welded wire reinforcement (WWR) conforming to ASTM A1064. Observe the relations shown in Table 2 among size number, diameter in inches, and area when ordering wire by size numbers, unless otherwise specified. Precede the size number for deformed wire with "D" and for smooth wire with "W."

Designate WWR as shown in the following example: 6 × 12 – W16 × W8 (indicating 6-in. longitudinal wire spacing and 12-in. transverse wire spacing with smooth No. 16 wire longitudinally and smooth No. 8 wire transversely).

Table 2
Wire Size Number, Diameter, and Area

Size Number (in.)	Diameter (in.)	Area (sq. in.)
31	0.628	0.310
30	0.618	0.300
28	0.597	0.280
26	0.575	0.260
24	0.553	0.240
22	0.529	0.220
20	0.505	0.200
18	0.479	0.180
16	0.451	0.160
14	0.422	0.140
12	0.391	0.120
10	0.357	0.100
8	0.319	0.080
7	0.299	0.070
6	0.276	0.060
5.5	0.265	0.055
5	0.252	0.050
4.5	0.239	0.045
4	0.226	0.040
3.5	0.211	0.035
2.9	0.192	0.035
2.5	0.178	0.025
2	0.160	0.020
1.4	0.134	0.014
1.2	0.124	0.012
0.5	0.080	0.005

Note—Size numbers (in.) are the nominal cross-sectional area of the wire in hundredths of a square inch. Fractional sizes between the sizes listed above are also available and acceptable for use.

- 2.7. **Epoxy Coating.** Provide epoxy coated reinforcing steel as shown on the plans. Before furnishing epoxy coated reinforcing steel, an epoxy applicator must be pre-approved in accordance with [DMS-7330](#), "Qualification Procedure for Reinforcing Steel Epoxy Coating Applicators." The Department's MPL has a list of approved applicators.

Furnish coated reinforcing steel meeting the requirements in Table 3.

Table 3
Epoxy Coating Requirements for Reinforcing Steel

Material	Specification
Bar	ASTM A775 or A934
Wire or WWR	ASTM A884 Class A or B
Mechanical couplers	As shown on the plans
Hardware	As shown on the plans

Use epoxy coating material and coating repair material that complies with [DMS-8130](#), "Epoxy Powder Coating for Reinforcing Steel." Patch no more than 1/4-in. total length in any foot at the applicator's plant.

Maintain identification of all reinforcing steel throughout the coating and fabrication process and until delivery to the project site.

Furnish 1 copy of a written certification verifying the coated reinforcing steel meets the requirements of this Item and 1 copy of the manufacturer's control tests.

- 2.8. **Mechanical Couplers.** Use couplers of the type specified in [DMS-4510](#), "Mechanical Couplers for Reinforcing Steel," Article 4510.5.A, "General Requirements," when mechanical splices in reinforcing steel bars are shown on the plans.

Furnish only couplers pre-qualified in accordance with [DMS-4510](#), “Mechanical Couplers for Reinforcing Steel.” Ensure sleeve-wedge type couplers are not used on coated reinforcing. Sample and test couplers for use on individual projects in accordance with [DMS-4510](#), “Mechanical Couplers for Reinforcing Steel.” Furnish couplers only at locations shown on the plans.

Furnish couplers for stainless reinforcing steel with the same alloy designation as the reinforcing steel.

2.9. **Fibers.** Supply fibers conforming to [DMS-4550](#) “Fibers for Concrete” at the minimum dosage listed in the Department’s MPL, when allowed by the plans. Use non-metallic fibers when shown on the plans.

2.10. **Stainless Reinforcing Steel.** Provide deformed steel bars of the types listed in Table 4 and conforming to ASTM A955, Grade 60 or higher when stainless reinforcing steel is required on the plans.

Table 4
Acceptable Types of Deformed Stainless Steel Bar

UNS Designation	S31653	S31803	S24100	S32304
AISI Type	316LN	2205	XM-28	2304

2.11. **Low Carbon/Chromium Reinforcing Steel.** Provide deformed steel bars conforming to ASTM A1035, Grade 100 when low carbon/chromium reinforcing steel is required on the plans.

2.12. **Dual-Coated Reinforcing Steel.** Provide deformed bars conforming to ASTM A1055, Grade 60 or higher when dual-coated reinforcing steel is required on the plans.

2.13. **Glass Fiber Reinforced Polymer Bars (GFRP).** Provide bars conforming to the AASHTO LRFD *Bridge Design Guide Specifications for GFRP-Reinforced Concrete Bridge Decks and Traffic Railings*, Section 4, “Material Specifications” when GFRP bars are required on the plans. Provide sample certification demonstrating the GFRP bar supplier has produced bar that meets the Material Specifications 2 mo. before fabrication. Furnish certification upon shipment that the GFRP bar supplied meets the Material Specifications.

3. CONSTRUCTION

3.1. **Bending.** Fabricate reinforcing steel bars as prescribed in the CRSI *Manual of Standard Practice* to the shapes and dimensions shown on the plans. Fabricate in the shop if possible. Field-fabricate, if permitted, using a method approved by the Engineer. Replace improperly fabricated, damaged, or broken bars at no additional expense to the Department. Repair damaged or broken bars embedded in a previous concrete placement using a method approved by the Engineer.

Unless otherwise shown on the plans, the inside diameter of bar bends, in terms of the nominal bar diameter (d), must be as shown in Table 5.

Table 5
Minimum Inside Diameter of Bar Bends

Bend	Bar Size Number (in.)	Pin Diameter
Bends of 90° and greater in stirrups, ties, and other secondary bars that enclose another bar in the bend	3, 4, 5	4d
	6, 7, 8	6d
Bends in main bars and in secondary bars not covered above	3 through 8	6d
	9, 10, 11	8d
	14, 18	10d

Bend-test representative specimens as described for smaller bars in the applicable ASTM specification where bending No. 14 or No. 18 Grade 60 bars is required. Make the required 90° bend around a pin with a diameter of 10 times the nominal diameter of the bar.

Bend stainless reinforcing steel in accordance with ASTM A955.

3.2. **Tolerances.** Fabrication tolerances for bars are shown in Figure 1.

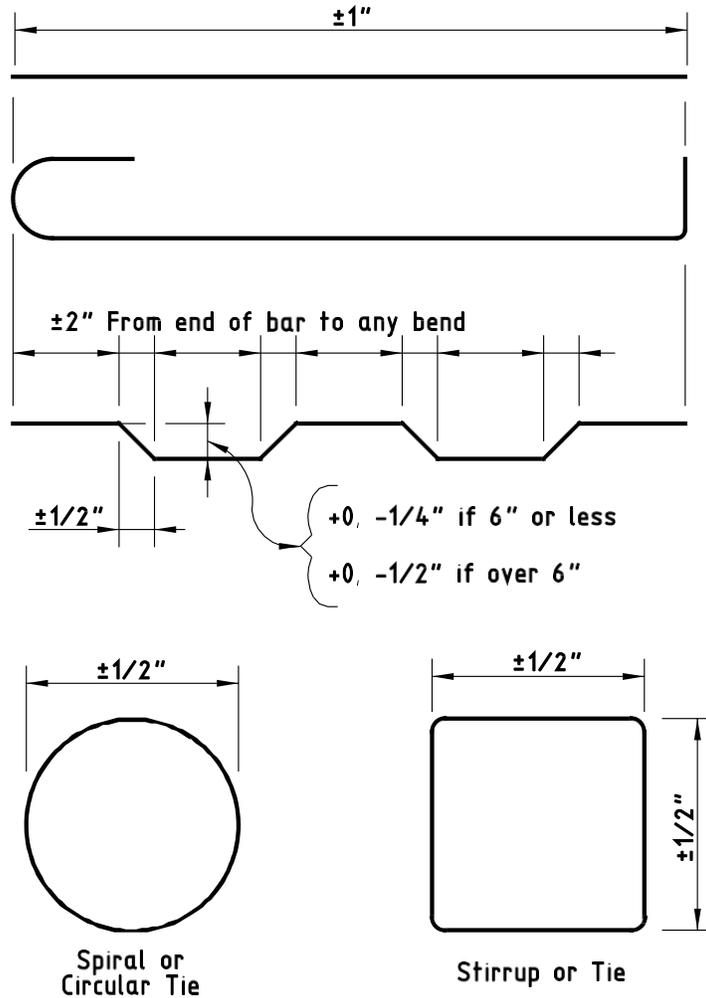


Figure 1
Fabrication Tolerances for Bars

- 3.3. **Storage.** Store reinforcement above the ground on platforms, skids, or other supports, and protect it from damage and deterioration. Ensure reinforcement is free from dirt, paint, grease, oil, and other foreign materials when it is placed in the work. Use reinforcement free from defects such as cracks and delaminations. Rust, surface seams, surface irregularities, or mill scale will not be cause for rejection if the minimum cross-sectional area of a hand wire-brushed specimen meets the requirements for the size of steel specified.

Do not allow stainless reinforcing steel to be in direct contact with uncoated reinforcing steel, nor with galvanized reinforcing steel. This does not apply to stainless steel wires and ties. Store stainless reinforcing steel separately, off the ground on wooden supports.

- 3.4. **Splices.** Lap-splice, weld-splice, or mechanically splice bars as shown on the plans. Additional splices not shown on the plans will require approval. Splices not shown on the plans will be permitted in slabs no more than 15 in. in thickness, columns, walls, and parapets.
- Do not splice bars less than 30 ft. in plan length unless otherwise approved. For bars exceeding 30 ft. in plan length, the distance center-to-center of splices must be at least 30 ft. minus 1 splice length, with no more than 1 individual bar length less than 10 ft. Make lap splices not shown on the plans, but otherwise

permitted, in accordance with Table 6. Maintain the specified concrete cover and spacing at splices, and place the lap-spliced bars in contact, securely tied together.

Table 6
Minimum Lap Requirements for Steel Bar Sizes through No. 11

Bar Size Number (in.)	Uncoated Lap Length	Coated Lap Length
3	1 ft. 4 in.	2 ft. 0 in.
4	1 ft. 9 in.	2 ft. 8 in.
5	2 ft. 2 in.	3 ft. 3 in.
6	2 ft. 7 in.	3 ft. 11 in.
7	3 ft. 5 in.	5 ft. 2 in.
8	4 ft. 6 in.	6 ft. 9 in.
9	5 ft. 8 in.	8 ft. 6 in.
10	7 ft. 3 in.	10 ft. 11 in.
11	8 ft. 11 in.	13 ft. 5 in.

- Do not lap No. 14 or No. 18 bars.
- Lap spiral steel at least 1 turn.
- Splice WWR using a lap length that includes the overlap of at least 2 cross wires plus 2 in. on each sheet or roll. Splices using bars that develop equivalent strength and are lapped in accordance with Table 6 are permitted.
- Lap the existing longitudinal bars with the new bars as shown in Table 6 for box culvert extensions with less than 1 ft. of fill. Lap at least 1 ft. 0 in. for extensions with more than 1 ft. of fill.
- Ensure welded splices conform to the requirements of the plans and of Item 448, "Structural Field Welding." Field-prepare ends of reinforcing bars if they will be butt-welded. Delivered bars must be long enough to permit weld preparation.
- Install mechanical coupling devices in accordance with the manufacturer's recommendations at locations shown on the plans. Protect threaded male or female connections, and ensure the threaded connections are clean when making the connection. Do not repair damaged threads.
- Mechanical coupler alternate equivalent strength arrangements, to be accomplished by substituting larger bar sizes or more bars, will be considered if approved in writing before fabrication of the systems.

3.5. **Placing.** Place reinforcement as near as possible to the position shown on the plans. Do not vary bars from plan placement by more than 1/12 of the spacing between bars in the plane of the bar parallel to the nearest surface of concrete. Do not vary bars from plan placement by more than 1/4 in in the plane of the bar perpendicular to the nearest surface of concrete. Provide a minimum 1-in. clear cover of concrete to the nearest surface of bar unless otherwise shown on the plans.

For bridge slabs, the clear cover tolerance for the top mat of reinforcement is -0, +1/2 in.

Locate the reinforcement accurately in the forms, and hold it firmly in place before and during concrete placement by means of bar supports that are adequate in strength and number to prevent displacement and keep the reinforcement at the proper distance from the forms. Provide bar supports in accordance with the CRSI *Manual of Standard Practice*. Use Class 1 supports, approved plastic bar supports, precast mortar, or concrete blocks when supports are in contact with removable or stay-in-place forms. Use Class 3 supports in slab overlays on concrete panels or on existing concrete slabs. Bar supports in contact with soil or subgrade must be approved.

Use Class 1A supports with epoxy coated reinforcing steel. Provide epoxy or plastic coated tie wires and clips for use with epoxy coated reinforcing steel.

Use mortar or concrete with a minimum compressive strength of 5,000 psi for precast bar supports. Provide a suitable tie wire in each block for anchoring to the bar.

Place individual bar supports in rows at 4-ft. maximum spacing in each direction. Place continuous type bar supports at 4-ft. maximum spacing. Use continuous bar supports with permanent metal deck forms.

The exposure of the ends of longitudinals, stirrups, and spacers used to position the reinforcement in concrete pipe and storm drains is not cause for rejection.

Tie reinforcement for bridge slabs and top slabs of direct traffic culverts at all intersections, except tie only alternate intersections where spacing is less than 1 ft. in each direction. Tie the bars at enough intersections to provide a rigid cage of reinforcement for reinforcement cages for other structural members. Fasten mats of WWR securely at the ends and edges.

Clean mortar, mud, dirt, debris, oil, and other foreign material from the reinforcement before concrete placement. Do not place concrete until authorized.

Stop placement until corrective measures are taken if reinforcement is not adequately supported or tied to resist settlement, reinforcement is floating upward, truss bars are overturning, or movement is detected in any direction during concrete placement.

3.6. **Handling, Placing, and Repairing Epoxy Coated Reinforcing Steel.**

3.6.1. **Handling.** Provide systems for handling coated reinforcing steel with padded contact areas. Pad bundling bands or use suitable banding to prevent damage to the coating. Lift bundles of coated reinforcement with a strongback, spreader bar, multiple supports, or a platform bridge. Transport the bundled reinforcement carefully, and store it on protective cribbing. Do not drop or drag the coated reinforcement.

3.6.2. **Placing.** Do not flame-cut coated reinforcement. Saw or shear-cut only when approved. Coat cut ends as specified in Section 440.3.6.3., "Repairing Coating."

Do not weld or mechanically couple coated reinforcing steel except where specifically shown on the plans. Remove the epoxy coating at least 6 in. beyond the weld limits before welding and 2 in. beyond the limits of the coupler before assembly. Clean the steel of oil, grease, moisture, dirt, welding contamination (slag or acid residue), and rust to a near-white finish after welding or coupling. Check the existing epoxy for damage. Remove any damaged or loose epoxy back to sound epoxy coating.

Coat the splice area after cleaning with epoxy repair material to a thickness of 7 to 17 mils after curing. Apply a second application of repair material to the bar and coupler interface to ensure complete sealing of the joint.

3.6.3. **Repairing Coating.** Use material that complies with the requirements of this Item and ASTM D3963 for repairing of the coating. Make repairs in accordance with procedures recommended by the manufacturer of the epoxy coating powder. Apply at least the same coating thickness as required for the original coating for areas to be patched. Repair all visible damage to the coating.

Repair sawed and sheared ends, cuts, breaks, and other damage promptly before additional oxidation occurs. Clean areas to be repaired to ensure they are free from surface contaminants. Make repairs in the shop or field as required.

3.7. **Handling and Placing Stainless Reinforcing Steel.** Handle, cut, and place stainless reinforcing steel bar using tools that are not used on carbon steel. Do not use carbon steel tools, chains, slings, etc. when handling stainless steel. Use only nylon or polypropylene slings. Cut stainless steel reinforcing using shears, saws, abrasive cutoff wheels, or torches. Remove any thermal oxidation using pickling paste. Do not field bend stainless steel reinforcing without approval.

Use 16 gauge fully annealed stainless steel tie wire conforming to the material properties listed in Section 440.2.10., "Stainless Reinforcing Steel." Support all stainless reinforcing steel on solid plastic, stainless steel, or epoxy coated steel chairs. Do not use uncoated carbon steel chairs in contact with stainless reinforcing steel.

- 3.8. **Bending, Handling, Repairing, and Placing GFRP Bars.** Fabricate, handle, repair, and place GFRP bars in accordance with the AASHTO LRFD Bridge Design Guide Specifications for GFRP-Reinforced Concrete Bridge Decks and Traffic Railings, Section 5, Construction Specifications.

4. MEASUREMENT AND PAYMENT

The work performed, materials furnished, equipment, labor, tools, and incidentals will not be measured or paid for directly but will be considered subsidiary to pertinent Items.

Item 500

Mobilization



1. DESCRIPTION

Establish and remove offices, plants, and facilities. Move personnel, equipment, and supplies to and from the project or the vicinity of the project site to begin work or complete work on Contract Items. Bonds and insurance are required for performing mobilization.

For Contracts with emergency mobilization, provide a person and method of contact available 24 hrs. a day, 7 days a week unless otherwise shown on the plans. The time of notice will be the transmission time of the written notice or notice provided orally by the Department's representative.

2. MEASUREMENT

This Item will be measured by the lump sum or each as the work progresses. Mobilization is calculated on the base bid only and will not be paid for separately on any additive alternate items added to the Contract.

3. PAYMENT

For this Item, the adjusted Contract amount will be calculated as the total Contract amount less the lump sum for mobilization. Except for Contracts with callout or emergency work, mobilization will be paid in partial payments as follows:

- Payment will be made upon presentation of a paid invoice for the payment or performance bonds and required insurance,
- Payment will be made upon verification of documented expenditures for plant and facility setup. The combined amount for all these facilities will be no more than 10% of the mobilization lump sum or 1% of the total Contract amount, whichever is less,
- When 1% of the adjusted Contract amount for construction Items is earned, 50% of the mobilization lump sum bid or 5% of the total Contract amount, whichever is less, will be paid. Previous payments under this Item will be deducted from this amount,
- When 5% of the adjusted Contract amount for construction Items is earned, 75% of the mobilization lump sum bid or 10% of the total Contract amount, whichever is less, will be paid. Previous payments under the Item will be deducted from this amount,
- When 10% of the adjusted Contract amount for construction Items is earned, 90% of the mobilization lump sum bid or 10% of the total Contract amount, whichever is less, will be paid. Previous payments under this Item will be deducted from this amount,
- Upon final acceptance, 97% of the mobilization lump sum bid will be paid. Previous payments under this Item will be deducted from this amount, and
- Payment for the remainder of the lump sum bid for "Mobilization" will be made after all submittals are received, final quantities have been determined and when any separate vegetative establishment and maintenance, test, and performance periods provided for in the Contract have been successfully completed.

For projects with extended maintenance or performance periods, payment for the remainder of the lump sum bid for "Mobilization" will be made 6 months after final acceptance.

For Contracts with callout or emergency work, "Mobilization," will be paid as follows:

- Payment will be made upon presentation of a paid invoice for the payment of performance bonds and required insurance,
- Mobilization for callout work will be paid for each callout work request, and
- Mobilization for emergency work will be paid for each emergency work request.

Item 502

Barricades, Signs, and Traffic Handling



1. DESCRIPTION

Provide, install, move, replace, maintain, clean, and remove all traffic control devices shown on the plans and as directed.

2. CONSTRUCTION

Comply with the requirements of Article 7.2., "Safety."

Implement the traffic control plan (TCP) shown on the plans.

Install traffic control devices straight and plumb. Make changes to the TCP only as approved. Minor adjustments to meet field conditions are allowed.

Submit Contractor-proposed TCP changes, signed and sealed by a licensed professional engineer, for approval. The Engineer may develop, sign, and seal Contractor-proposed changes. Changes must conform to guidelines established in the TMUTCD using approved products from the Department's Compliant Work Zone Traffic Control Device List.

Maintain traffic control devices by taking corrective action when notified. Corrective actions include, but are not limited to, cleaning, replacing, straightening, covering, and removing devices. Maintain the devices such that they are properly positioned and spaced, legible, and have retroreflective characteristics that meet requirements day or night and in all weather conditions.

The Engineer may authorize or direct in writing the removal or relocation of project limit advance warning signs. When project limit advance warning signs are removed before final acceptance, provide traffic control in accordance with the TMUTCD for minor operations as approved.

Remove all traffic control devices upon completion of the work as shown on the plans or as directed.

3. MEASUREMENT

Barricades, Signs, and Traffic Handling will be measured by the month. Law enforcement personnel with patrol vehicles will be measured by the hour for each person.

4. PAYMENT

- 4.1. **Barricades, Signs, and Traffic Handling.** Except for Contracts with callout work and work orders, the work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Barricades, Signs, and Traffic Handling." This price is full compensation for installation, maintenance, adjustments, replacements, removal, materials, equipment, labor, tools, and incidentals.

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Barricades, Signs, and Traffic Handling." This price is full compensation for installation, maintenance, adjustments, replacements, removal, materials, equipment, labor, tools, and incidentals.

When the plans establish pay items for particular work in the TCP, that work will be measured and paid under pertinent Items.

4.1.1. **Initiation of Payment.** Payment for this Item will begin on the first estimate after barricades, signs, and traffic handling devices have been installed in accordance with the TCP and construction has begun.

4.1.2. **Paid Months.** Monthly payment will be made each succeeding month for this Item provided the barricades, signs, and traffic handling devices have been installed and maintained in accordance with the TCP until the Contract amount has been paid.

If, within the time frame established by the Engineer, the Contractor fails to provide or properly maintain signs and barricades in compliance with the Contract requirements, as determined by the Engineer, the Contractor will be considered in noncompliance with this Item. No payment will be made for the months in question, and the total final payment quantity will be reduced by the number of months the Contractor was in noncompliance.

4.1.3. **Maximum Total Payment Before Acceptance.** The total payment for this Item will not exceed 10% of the total Contract amount before final acceptance in accordance with Article 5.12., "Final Acceptance." The remaining balance will be paid in accordance with Section 502.4.1.5., "Balance Due."

4.1.4. **Total Payment Quantity.** The quantity paid under this Item will not exceed the total quantity shown on the plans except as modified by change order and as adjusted by Section 502.4.1.2., "Paid Months." An overrun of the plans quantity for this Item will not be allowed for approving designs; testing; material shortages; closed construction seasons; curing periods; establishment, performance, test, and maintenance periods; failure to complete the work in the number of months allotted; nor delays caused directly or indirectly by requirements of the Contract.

4.1.5. **Balance Due.** The remaining unpaid months of barricades less non-compliance months will be paid on final acceptance of the project, if all work is complete and accepted in accordance with Article 5.12., "Final Acceptance."

4.1.6. **Contracts with Callout Work and Work Orders.** The work performed and the materials furnished with this Item and measured as provided under "Measurement," will be considered subsidiary to pertinent Items, except for federally funded Contracts.

4.2. **Law Enforcement Personnel.** The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement," will be paid by Contractor force account for "Law Enforcement Personnel." This price is full compensation for furnishing all labor, materials, supplies, equipment, patrol vehicle, fees, and incidentals necessary to complete the work as directed.

Item 512

Portable Traffic Barrier



1. DESCRIPTION

Furnish, install, move, and remove portable traffic barrier.

2. MATERIALS

2.1. Furnished by the Contractor.

2.1.1. **Concrete.** Furnish barrier of the class of concrete shown and using materials that meet the pertinent requirements of the following items:

- Item 420, "Concrete Substructures"
- Item 421, "Hydraulic Cement Concrete"
- Item 424, "Precast Concrete Structural Members (Fabrication)"
- Item 440, "Reinforcement for Concrete"
- Item 442, "Metal for Structures"

2.1.2. **Steel.** Barrier sections will be furnished when shown on the plans. Barrier sections must meet the crash testing requirements of NCHRP 350 or MASH TL-3 or TL-4 specifications as per test matrix for Longitudinal Barriers.

2.1.3. **Concrete and Steel.** When barrier is to be furnished and retained by the Contractor, products from nonapproved sources or previously used products may be provided if the Contractor submits written certification that the barrier sections and materials substantially conform to the requirements of this Item. The Engineer may approve the use of the product if:

- the barrier sections substantially meet typical cross-section dimension requirements,
- there is no evidence of structural damage such as major spalls or cracks,
- the general condition of both the barrier sections and their connectors is acceptable,
- the barrier is new, and
- the barrier is being reused.

2.2. **Furnished by the Department.** Department-furnished barrier sections will be at a stockpile location or an existing traffic barrier installation shown on the plans.

3. CONSTRUCTION

Notify the Engineer of the location of the casting site and the date on which the work will begin. Multi-project fabrication plants as defined in Item 424, "Precast Concrete Structural Members (Fabrication)," that produce concrete traffic barrier, except temporary barrier furnished and retained by the Contractor, must be qualified in accordance with [DMS-7350](#), "Qualification Procedure for Multi-Project Fabrication Plants of Precast Concrete Traffic Barrier." See the Department's MPL for approved fabricators. Construct barrier in accordance with Item 420, "Concrete Substructures," to the dimensions and cross-sections shown on the plans. Provide forms and cure concrete in accordance with Item 424, "Precast Concrete Structural Members (Fabrication)."

Provide a rough texture to the bottom surface of Single Slope or F-Shape barriers and to the top of Low Profile barriers similar to a wood float finish.

Remove formwork after the concrete has reached sufficient strength to prevent physical damage to the member. Move barrier sections to a storage area and place them on blocking to prevent damage when they have attained sufficient strength to permit handling without causing visible damage.

Produce precast barrier to the tolerances given in Table 1 unless otherwise shown on the plans.

**Table 1
Precast Barrier Tolerances**

Dimension	Tolerance
Length	±1 in.
Insert Placement	±1/2 in.
Horizontal Alignment	±1/8 in. per 10 feet of length
Deviation of Ends:	
Horizontal Skew	±1/4 in.
Vertical Batter	±1/8 in. per foot of depth

Install the barrier sections in accordance with the details shown on the plans or as directed.

After use, stockpile barrier sections and connection hardware that are to be retained by the Department at the location shown on the plans or as otherwise directed. Obtain assembly and installation information for the portable steel traffic barrier from the manufacturer, and provide the Engineer with an installation and repair manual specific to the portable steel traffic barrier.

Repair or replace all traffic barrier or connecting hardware damaged by the Contractor's operations at the Contractor's expense.

Repair or replace any pavement damaged in the process of installing, moving, or removing barrier sections at the Contractor's expense.

4. MEASUREMENT

This Item will be measured by the foot based on the nominal lengths of the barrier sections.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price as follows:

- For concrete barrier only, bid for "Portable Traffic Barrier" of the work category (Furnish and Install, Designated Source, Move, Stockpile, or Remove), shape (e.g., Single Slope, F-Shape, or Low Profile) and Type (1, 2, 3, etc.) of barrier sections specified. This price includes equipment, labor, tools, and incidentals.
- For concrete and steel barrier, bid for "Portable Traffic Barrier" of the work category (Furnish and Install, Designated Source, Move, Stockpile, or Remove), shape (e.g., Single Slope, F-Shape, or Low Profile) and Type (1, 2, 3, etc.) of barrier sections specified or "Steel". This price includes equipment, labor, tools, and incidentals.

- 5.1. **Furnish and Install.** This price is full compensation for furnishing and installing barrier sections and connection hardware.
- 5.2. **Designated Source.** This price is full compensation for delivering and installing Department-furnished barrier sections and connection hardware from a designated source.
- 5.3. **Move.** This price is full compensation for moving barrier section installations on the project from one location to another (including disassembly and reassembly costs), moving barrier sections from an installation on the project to a temporary storage area (including disassembly costs), and moving barrier sections from a temporary storage area to an installation site on the project (including assembly costs).

- 5.4. **Stockpile.** This price is full compensation for removing barrier sections and connection hardware from the project and delivering to the Department stockpile area shown on the plans or as directed.
- 5.5. **Remove.** This price is full compensation for removing barrier and connection hardware from the project and retained by the Contractor.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 529

Concrete Curb, Gutter, and Combined Curb and Gutter



1. DESCRIPTION

Construct hydraulic cement concrete curb, gutter, and combined curb and gutter.

2. MATERIALS

Furnish materials conforming to:

- Item 360, "Concrete Pavement"
- Item 420, "Concrete Substructures"
- Item 421, "Hydraulic Cement Concrete"
- Item 440, "Reinforcement for Concrete"

Use Class A concrete or material specified on the plans. Use Grade 8 coarse aggregate for extruded Class A concrete. Use other grades if approved.

When approved, use fibers meeting the requirements of [DMS-4550](#), "Fibers for Concrete," to replace reinforcing steel in Class A concrete. Dose fibers in accordance with the Department's MPL of pre-qualified fibers for concrete.

3. CONSTRUCTION

Provide finished work with a well-compacted mass and a surface free from voids and honeycomb, in the required shape, line, and grade. Round exposed edges with an edging tool of the radius shown on the plans. Mix, place, and cure concrete in accordance with Item 420, "Concrete Substructures." Construct joints at locations shown on the plans. Cure for at least 72 hr.

Furnish and place reinforcing steel in accordance with Item 440, "Reinforcement for Concrete."

Set and maintain a guideline that conforms to alignment data shown on the plans, with an outline that conforms to the details shown on the plans. Ensure that changes in curb grade and alignment do not exceed 1/4 in. between any 2 contacts on a 10-ft. straightedge.

- 3.1. **Conventionally Formed Concrete.** Shape and compact subgrade, foundation, or pavement surface to the line, grade, and cross-section shown on the plans. Lightly sprinkle subgrade or foundation material immediately before concrete placement.

Pour concrete into forms, and strike off with a template 1/4 to 3/8 in. less than the dimensions of the finished curb unless otherwise approved. After initial set, plaster surface with mortar consisting of 1 part hydraulic cement and 2 parts fine aggregate. Brush exposed surfaces to a uniform texture.

Place curbs, gutters, and combined curb and gutters in 50-ft. maximum sections unless otherwise approved.

- 3.2. **Extruded or Slipformed Concrete.** Hand-tamp and sprinkle subgrade or foundation material before concrete placement. Provide clean surfaces for concrete placement. Coat cleaned surfaces, if required, with approved adhesive or coating at the rate of application shown on the plans or as directed. Place concrete with approved self-propelled equipment.

The forming tube of the extrusion machine or the form of the slipform machine must be easily adjustable vertically during the forward motion of the machine to provide variable heights necessary to conform to the established gradeline.

Attach a pointer or gauge to the machine so that a continual comparison can be made between the extruded or slipform work and the grade guideline. Other methods may be used when approved.

Finish surfaces immediately after extrusion or slipforming.

4. MEASUREMENT

This Item will be measured by the foot.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Concrete Curb," "Concrete Curb (Mono)," or "Concrete Curb and Gutter" of the type specified. This price is full compensation for surface preparation of curb foundation, equipment, labor, materials, tools, and incidentals.

Item 636

Signs



1. DESCRIPTION

- **Installation.** Furnish, fabricate, and erect aluminum signs. Sign supports are provided for under other Items.
- **Replacement.** Replace existing signs on existing sign supports.
- **Refurbishing.** Refurbish existing aluminum signs on existing sign supports.

2. MATERIALS

- 2.1. **Sign Blanks.** Furnish sign blank substrates in accordance with [DMS-7110](#), "Aluminum Sign Blanks," and in accordance with the types shown on the plans. Use single-piece sheet-aluminum substrates for Type A (small) signs and extruded aluminum substrates for Type G (ground-mounted) or Type O (overhead-mounted) signs.
- 2.2. **Sign Face Retroreflectorization.** Retroreflectorize the sign faces with flat surface reflective sheeting. Furnish sheeting that meets [DMS-8300](#), "Sign Face Materials." Use retroreflective sheeting from the same manufacturer for the entire sign face background. Ensure that sign legend, symbols, borders, and background exhibit uniform color, appearance, and retroreflectivity when viewed both day and night.
- 2.3. **Sign Messages.** Fabricate sign messages to the sizes, types, and colors shown on the plans. Use sign message material from the same manufacturer for the entire message of a sign. Use screen ink and background reflective sheeting that are from the same manufacturer when fabricating signs.
- Ensure that the screened messages have clean, sharp edges and exhibit uniform color and retroreflectivity. Prevent runs, sags, and voids. Furnish screen inks in accordance with [DMS-8300](#), "Sign Face Materials."
 - Fabricate colored, transparent film legend, and retroreflectorized sheeting legend from materials that meet [DMS-8300](#), "Sign Face Materials."
 - Fabricate non-reflective black film legend from materials meeting [DMS-8300](#), "Sign Face Materials."
 - Furnish direct-applied route markers and other attachments within the parent sign face unless otherwise specified on the plans.
- 2.4. **Hardware.** Use galvanized steel, stainless steel, or dichromate-sealed aluminum for bolts, nuts, washers, lock washers, screws, and other sign assembly hardware. Use plastic or nylon washers to avoid tearing the reflective sheeting. Furnish steel or aluminum products in accordance with [DMS-7120](#), "Sign Hardware."

When dissimilar metals are used, select or insulate metals to prevent corrosion.

3. CONSTRUCTION

- 3.1. **Fabrication.** Sign fabrication plants that produce permanent highway signs must be approved in accordance with DMS-7390, "Permanent Highway Sign Fabrication Plant Qualification." Furnish signs from prequalified fabrication plants listed in the Department's MPL.
- 3.1.1. **Sign Blanks.** Furnish sign blanks to the sizes and shapes shown on the plans and that are free of buckles, warps, burrs, dents, cockles, or other defects. Do not splice individual extruded aluminum panels.

Complete the fabrication of sign blanks, including the cutting and drilling or punching of holes, before cleaning and degreasing. After cleaning and degreasing, ensure the substrate does not come into contact with grease, oils, or other contaminants before the application of the reflective sheeting.

- 3.1.2. **Sheeting Application.** Apply sheeting to sign blanks in conformance with the sheeting manufacturer's recommended procedures.

When using rotational sensitive white sheeting, fabricate signs by applying the sheeting for cut-out legend, symbols, borders, and route marker attachments within the parent sign face with the identification marks or other orientation features in the optimum rotation as identified by the sheeting manufacturer.

Clean and prepare the outside surface of extruded aluminum flanges in the same manner as the sign panel face.

Minimize the number of splices in the sheeting. Overlap the lap-splices by at least 1/4 in. for encapsulated glass bead sheeting unless otherwise recommended by the reflective sheeting manufacturer. Use butt splices for prismatic reflective sheeting. Provide a 1 ft. minimum dimension for any piece of sheeting. Do not splice sheeting for signs fabricated with transparent screen inks or colored transparent films.

- 3.1.3. **Sign Assembly.** Assemble extruded aluminum signs in accordance with the details shown on the plans. Sign face surface variation must not exceed 1/8 in. per foot. Surface misalignment between panels in multi-panel signs must not exceed 1/16 in. at any point.

- 3.1.4. **Decals.** Code and apply sign identification decals in accordance with Item 643, "Sign Identification Decals."

- 3.2. **Storage and Handling.** Ship, handle, and store completed sign blanks and completed signs so that corners, edges, and faces are not damaged. Damage to the sign face that is not visible when viewed at a distance of 50 ft., night or day, will be acceptable. Replace unacceptable signs.

Store all finished signs off the ground and in a vertical position until erected. Store finished sheet aluminum substrate signs in a weatherproof building. Extruded aluminum substrate signs may be stored outside.

Stockpile salvageable materials at the location shown on the plans or as directed. Accept ownership of unsalvageable materials and dispose of them in accordance with federal, state, and local regulations.

- 3.3. **Cleaning.** Wash completed signs in the fabrication shop with a biodegradable cleaning solution acceptable to the manufacturers of the sheeting, colored transparent film, and screen ink to remove grease, oil, dirt, smears, streaks, finger marks, and other foreign material. Wash again before final inspection after erection.

- 3.4. **Installation.** Install signs as shown on the plans or as directed.

- 3.5. **Replacement.** Remove the existing signs from the existing supports and replace with new signs, including mounting hardware, as shown on the plans.

- 3.6. **Refurbishing.** Refurbish existing signs by providing and installing new messages and mounting hardware. Install new retroreflectorized legend and supplemental signs as shown on the plans.

- 3.7. **Documentation.** Provide the following documentation from the sign fabricator with each shipment of furnished signs:

- A notarized original of the Signing Material Statement (Form 2273) with the proper attachments for verification of compliance, and
- A notarized certification stating that the completed signs were fabricated in accordance with this Item and the plans.

4. MEASUREMENT

Signs installed or replaced will be measured by the square foot of the sign face. Signs refurbished will be measured by each sign.

This is a plans quantity measurement item. The quantity to be paid is the quantity shown in the proposal, unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

5. PAYMENT

The work performed and materials furnished in accordance with this item and measured as provided under "Measurement" will be paid for at the unit price bid for "Aluminum Signs," "Replacing Existing Aluminum Signs," or "Refurbishing Aluminum Signs," of the type specified.

- 5.1. **Installation.** This price is full compensation for furnishing and installing new signs and hardware; fabrication of sign panels; treatment of sign panels required before application of the background materials; application of the background materials and messages to the sign panels; furnishing and fabricating frames, wind beams and stiffeners; furnishing bolts, rivets, screws, fasteners, clamps, brackets, and sign support connections; assembling and erecting the signs; preparing and cleaning the signs; and materials, equipment, labor, tools, and incidentals.
- 5.2. **Replacement.** This price is full compensation for furnishing and installing new aluminum signs and hardware; removal of existing signs; fabrication of sign panels; treatment of sign panels required before application of the background materials; application of the background materials and messages to the sign panels; furnishing and fabricating frames, wind beams and stiffeners; furnishing bolts, rivets, screws, fasteners, clamps, brackets, and sign support connections; assembling and erecting the signs; preparing and cleaning the signs; salvaging and disposing of unsalvageable materials; and materials, equipment, labor, tools, and incidentals.
- 5.3. **Refurbishing.** This price is full compensation for modifying existing sign messages; removing and replacing existing route markers, reflectorized legend, or supplemental signs attached to the parent sign; preparing and cleaning the signs; furnishing sheeting and hardware; salvaging and disposing of unsalvageable materials; and materials, equipment, labor, tools, and incidentals.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 643

Sign Identification Decals



1. DESCRIPTION

Furnish and install sign identification decals.

2. MATERIALS

Furnish materials that meet the requirements of [DMS-8315](#), "Sign Identification Decals."

Figure 1 shows the sign identification decal design. Table 1 describes the information required in each row of the decal.

Texas Department of Transportation												
C	Fabrication Date										T	1
J	F	M	A	M	J	J	A	S	O	N	D	2
	201		202		203		204		205			3
	0	1	2	3	4	5	6	7	8	9		4
Sheeting MFR - Substrate												
A	B	C	D	E	F	G	H	J	K	L	M	5
Film MFR												
A	B	C	D	E	F	G	H	J	K	L	M	6
Sheeting MFR - Legend												
A	B	C	D	E	F	G	H	J	K	L	M	7
Installation Date												
				0	1	2	3					8
	0	1	2	3	4	5	6	7	8	9		9
J	F	M	A	M	J	J	A	S	O	N	D	10
	201		202		203		204		205			11
	0	1	2	3	4	5	6	7	8	9		12

Figure 1
Decal Design (Row numbers explained in Table 1.)

Table 1
Decal Description
Row Explanation

1	– Sign Fabricator
2	– Month Fabricated
3	– First 3 Digits of Year Fabricated
4	– Last Digit of Year Fabricated
5	– Manufacturer of the Sheeting Applied to the Substrate
6	– Film (colored transparent or non-reflective black) Manufacturer
7	– Manufacturer of the Sheeting for the Legend
8	– Tens digit of Date Installed
9	– Ones Digit of Date Installed
10	– Month Installed
11	– First 3 Digits of Year Installed
12	– Last Digit of Year Installed

3. CONSTRUCTION

3.1. **Sign Fabricator.** Code the decal by punching out the following:

- “C” if fabricated by a commercial sign fabricator or “T” if fabricated by the Department or the Texas Department of Criminal Justice;
- month fabricated;
- first 3 digits of the year fabricated;
- fourth digit of the year fabricated; and
- sheeting, film, and ink manufacturers. (Codes for these manufacturers are located in the Department’s MPL.)

Affix decal to lower left corner of the sign back in an upright position.

4. MEASUREMENT AND PAYMENT

The work performed, materials furnished, equipment, labor, tools, and incidentals will not be measured or paid for directly but will be subsidiary to pertinent Items.

Item 644

Small Roadside Sign Assemblies



1. DESCRIPTION

- **Installation.** Furnish, fabricate, and erect small roadside sign assemblies or bridge mounted clearance sign assemblies consisting of the signs, sign supports, foundations (when required), and associated mounting hardware.
- **Relocation.** Relocate existing small roadside sign assemblies or bridge mounted clearance sign assemblies, and furnish and fabricate material as required.
- **Removal.** Remove existing small roadside sign assemblies or bridge mounted clearance sign assemblies.

2. MATERIALS

Furnish all materials unless otherwise shown on the plans. Furnish only new materials. Furnish and fabricate materials that comply with the following Items and details shown on the plans:

- Item 421, "Hydraulic Cement Concrete"
- Item 440, "Reinforcement for Concrete"
- Item 441, "Steel Structures"
- Item 442, "Metal for Structures"
- Item 445, "Galvanizing"
- Item 636, "Signs"
- Item 643, "Sign Identification Decals"
- Item 656, "Foundations for Traffic Control Devices"

Use galvanized steel, stainless steel, dichromate sealed aluminum, or other materials shown on the plans for pipe, bolts, nuts, washers, lock washers, screws, and other sign assembly hardware. When dissimilar metals are used, select or insulate metals to prevent corrosion.

3. CONSTRUCTION

Construct foundations in accordance with Item 656, "Foundations for Traffic Control Devices." Plumb sign supports. Do not spring or rake posts to secure proper alignment. Use established safety practices when working near underground or overhead utilities. Consult the appropriate utility company before beginning work.

- 3.1. **Fabrication.** Fabricate sign supports in accordance with Item 441, "Steel Structures." Ensure all components fit properly.

Verify the length of each post for each sign before fabrication to meet field conditions and sign-mounting heights shown on the plans.

Hot-dip galvanize fabricated parts in accordance with Item 445, "Galvanizing." Punch or drill any holes in steel parts or members before galvanizing. Repair galvanizing for any steel part or member damaged during assembly, transit, erection; or for any steel part or member welded, when permitted, after galvanizing. Perform all galvanizing repairs in accordance with Section 445.3.5., "Repairs."

- 3.2. **Installation.** Locate and install sign supports as shown on the plans, unless directed to shift the sign supports within design guidelines to secure a more desirable location or avoid conflict with utilities and underground appurtenances. Stake sign support locations for verification by the Engineer.
- Install stub posts of the type, spacing, orientation, and projection shown on the plans. Remove and replace posts damaged during installation at the Contractor's expense.
- Connect the upper post sections to the stub post sections as shown on the plans. Torque connection bolts as shown on the plans.
- Attach signs to supports in accordance with the plans and pertinent Items.
- 3.3. **Relocation.** Reuse the existing signs as required unless otherwise shown on the plans. Furnish and install new stub posts in new foundations for relocated sign assemblies. Erect the new supports on the new stub posts, and attach the existing signs to the supports in accordance with the plans and pertinent Items. Remove existing foundations to be abandoned in accordance with Section 644.3.4., "Removal."
- 3.4. **Removal.** Remove abandoned concrete foundations to 2 ft. below finish grade unless otherwise shown on the plans. Cut off and remove steel protruding from the remaining concrete. Backfill the remaining hole with material equal in composition and density to the surrounding area. Replace any surfacing with like material to equivalent condition.
- 3.5. **Handling and Storage.** Handle and store existing signs or portions of signs removed so they are not damaged. Prevent any damage to the various sign assembly components. Replace any portion of the sign damaged by the Contractor designated for reuse or salvage, including messages removed.
- Stockpile all removed sign components that will be reused or become the property of the Department at designated locations. Accept ownership of unsalvageable materials, and dispose of them in accordance with federal, state, and local regulations.
- 3.6. **Cleaning.** Wash the entire sign after installation with a biodegradable cleaning solution acceptable to the sign face materials manufacturer to remove dirt, grease, oil smears, streaks, finger marks, and other foreign materials.

4. MEASUREMENT

This Item will be measured as each small roadside assembly or bridge mounted clearance sign assembly installed, removed, or relocated.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Install Small Roadside Sign Assemblies" of the type specified, "Install Bridge Mounted Clearance Sign Assemblies" of the type specified, "Relocate Small Roadside Sign Assemblies" of the type specified, "Relocate Bridge Mounted Clearance Sign Assemblies" of the type specified, "Remove Small Roadside Sign Assemblies," or "Remove Bridge Mounted Clearance Sign Assemblies."

- 5.1. **Installation.** This price is full compensation for furnishing, fabricating, galvanizing, and erecting the supports; constructing foundations including concrete (when required); furnishing complete signs including sign connections and all hardware; attaching the signs to the supports; preparing and cleaning the signs; and materials, equipment, labor, tools, and incidentals.
- 5.2. **Relocation.** This price is full compensation for removing existing sign assemblies and related materials; furnishing and installing new stub posts and new sign supports; constructing foundations including concrete (when required); and new hardware; reinstallation of signs; preparing and cleaning the signs; salvaging;

disposal of unsalvageable materials; removing existing foundations, backfilling, and surface placement; and materials, equipment, labor, tools, and incidentals.

5.3.

Removal. This price is full compensation for removing existing sign assemblies and related materials; salvaging; disposal of unsalvageable materials; removing existing foundations, backfilling, and surface placement; and materials, equipment, labor, tools, and incidentals.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 656

Foundations for Traffic Control Devices



1. DESCRIPTION

Construct concrete foundations for small roadside signs, traffic signal controllers, pedestal poles, roadside flashing beacon assemblies, electrical services, and other small traffic control devices.

2. MATERIALS

Ensure materials and construction methods conform to the requirements of this Item and the pertinent requirements of the following Items:

- Item 400, "Excavation and Backfill for Structures"
- Item 416, "Drilled Shaft Foundations"
- Item 420, "Concrete Substructures"
- Item 421, "Hydraulic Cement Concrete"
- Item 432, "Riprap"
- Item 440, "Reinforcement for Concrete"
- Item 441, "Steel Structures"
- Item 442, "Metal for Structures"
- Item 445, "Galvanizing"
- Item 447, "Structural Bolting"
- Item 449, "Anchor Bolts"
- Item 618, "Conduit"

Use Class A concrete for non-reinforced drilled shafts. Use Class C concrete for reinforced drilled shafts. Use Class B concrete or polymer concrete composed of borosilicate glass fiber, catalyzed polyester resin, and aggregate for traffic signal controller foundations. Use drilled shaft or galvanized steel screw-in type foundations for roadside flashing beacon assemblies.

Use reinforcing steel when required.

3. CONSTRUCTION

Stake and install foundations as shown on the plans. The Engineer may shift the foundation locations within design guidelines where necessary to secure a more desirable location or avoid conflict with utilities. Use established industry and utility safety practices when working near underground or overhead utilities. Consult the appropriate utility before beginning work.

Hold anchor bolts in place with templates during concrete placement. Hold embedded items such as conduit or other hardware in place during concrete placement with templates or other approved means. Cap conduits before placing concrete. Ream conduit to remove burrs and sharp edges. Install bell ends or bushings on the conduit.

Carefully align foundation, posts, and anchor bolts. Do not spring or rake posts or anchor bolts.

Remove the top template after concrete has achieved initial set. Keep forms and other bracing intact until the concrete has cured at least one curing day.

Allow concrete for pedestal poles and roadside flashing beacon assemblies to cure at least 7 days before placing bases and poles on the foundation unless otherwise permitted in writing.

Allow concrete for traffic signal controller foundations and small roadside signs to cure at least 4 days before placing cabinets and posts on the foundation unless otherwise permitted.

Provide an ordinary surface finish to the concrete foundation extending above ground in accordance with Section 420.4.13., "Ordinary Surface Finish."

Place concrete riprap around the foundation in accordance with the plans.

Backfill disturbed surface with material equal in composition and density to the surrounding area. Replace surfacing material with similar material to an equivalent condition.

4. MEASUREMENT AND PAYMENT

The work performed, materials furnished, equipment, labor, tools, and incidentals will not be measured or paid for directly but will be subsidiary to pertinent Items.

Item 658

Delineator and Object Marker Assemblies



1. DESCRIPTION

- **Installation.** Install delineator or object maker assembly.
- **Removal.** Remove delineator or object marker assembly.

2. MATERIALS

Furnish only new materials in accordance with details shown on the plans unless otherwise directed. The Engineer will sample in accordance with [Tex-725-I](#) or [Tex-737-I](#).

2.1. **Delineator and Object Marker Assemblies.** Fabricate in accordance with the following:

- [DMS-8600](#), "Delineators, Object Markers, and Barrier Reflectors."
- [DMS-4400](#), "Flexible Delineator and Object Marker Posts (Embedded and Surface-Mount Types)."

2.2. **Wing Channel Post.** Furnish material of the size shown on the plans. Supply a notarized original of the Form D-9-USA-1 (Department Form 1818) with supporting mill test report certifying that the base metal is in accordance with the following:

- ASTM A1011, SS Grade 50.
- ASTM A499.

Galvanize material in accordance with Item 445, "Galvanizing."

3. CONSTRUCTION

3.1. **Installation.** Locate delineators and object markers as shown on the plans or as directed.

Locate barrier reflectors as shown on the plans or as directed, and install in accordance with manufacturers recommendations.

Install winged channel post and flexible delineator posts to allow the reflector units and reflectorized panels to be installed at the specified height and orientation. Align post as shown or as directed.

Drive post plumb using a driving cap to prevent visible cross-section dimension distortion. Drill or drive a pilot hole when post cannot be driven without visibly distorting the cross-section dimension. Backfill pilot holes thoroughly by tamping in 6-in. lifts to grade.

Install surface-mount and other types of delineators and object markers in accordance with details shown on the plans.

Repair damaged galvanizing in accordance with Section 445.3.5., "Repairs." Install reflector units on wing channel posts after the posts have been erected.

3.2. **Removal.** Remove post assemblies without damaging materials and salvage when indicated on the plans. Remove post to a minimum of 6 in. below finish grade. Stockpile salvaged materials at the location shown on the plans or as directed. Accept ownership of unsalvageable materials and dispose of in accordance with federal, state, and local requirements.

4. MEASUREMENT

Installation will be measured by each delineator or object marker assembly installed. When removal is specified on the plans to be a pay item, it will be measured by each delineator or object marker assembly removed.

This is a plans quantity measurement item. The quantity to be paid for is shown in the proposal unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

5. PAYMENT

The work performed and materials furnished in accordance with this item and measured as provided under "Measurement" will be paid for at the unit price bid for "Install Delineator Assemblies" or "Install Object Marker Assemblies" of the types and colors specified and for "Remove Delineator or Object Marker Assemblies."

5.1. **Installation.** This price is full compensation for furnishing and fabricating when required, and installing and mounting the delineator or object marker assemblies including posts, adhesive or pads for surface mount assemblies, back plates, reflector units, fastening plates, brackets, bolts, nuts, and washers; and materials, equipment, labor, tools, and incidentals.

5.2. **Removal.** Unless otherwise shown on the plans, removal will not be paid for directly but is subsidiary to bid items of the Contract.

When removal is shown on the plans as a bid item, this price is full compensation for removal and disposal of delineator and object marker assemblies and for materials, equipment, labor, tools, and incidentals.

Item 662

Work Zone Pavement Markings



1. DESCRIPTION

Furnish, place, and maintain work zone pavement markings.

2. MATERIALS

Provide thermoplastic, paint and beads, raised pavement markers (RPMs), prefabricated pavement markings, temporary flexible reflective roadway marker tabs, or other approved materials for work zone pavement markings.

Supply materials meeting:

- [DMS-4200](#), "Pavement Markers (Reflectorized),"
- [DMS-4300](#), "Traffic Buttons,"
- [DMS-8200](#), "Traffic Paint,"
- [DMS-8220](#), "Hot Applied Thermoplastic,"
- [DMS-8240](#), "Permanent Prefabricated Pavement Markings,"
- [DMS-8241](#), "Temporary (Removable) Prefabricated Pavement Markings,"
- [DMS-8242](#), "Temporary Flexible, Reflective Roadway Marker Tabs," and
- [DMS-8290](#), "Glass Traffic Beads."

2.1. **Nonremovable Markings.** Use hot-applied thermoplastic or permanent prefabricated pavement markings for nonremovable markings. Paint and beads or other materials are not allowed for nonremovable markings unless shown on the plans.

2.2. **Removable and Short-Term Markings.** Use RPMs, removable prefabricated pavement markings, temporary flexible reflective roadway marker tabs, or other approved materials for removable and short-term markings. Do not use hot-applied thermoplastic or traffic paint for removable markings. Use removable prefabricated pavement markings on the final pavement surface when the plans specify removable markings.

3. CONSTRUCTION

Apply pavement markings in accordance with the following Items.

- Item 666, "Retroreflectorized Pavement Markings"
- Item 668, "Prefabricated Pavement Markings"
- Item 672, "Raised Pavement Markers"

3.1. **Placement.** Install longitudinal markings on pavement surfaces before opening to traffic. Maintain lane alignment traffic control devices and operations until markings are installed. Install markings in proper alignment in accordance with the TMUTCD and as shown on the plans. Short-term markings will be allowed when standard markings (removable or nonremovable) cannot be placed before opening to traffic, if shown on the plans or directed.

When short-term markings are allowed for opening to traffic, place standard longitudinal markings no later than 14 calendar days after the placement of the surface. When inclement weather prohibits placement of markings, the 14-day period may be extended until weather permits proper application.

Place standard longitudinal markings no sooner than 3 calendar days after the placement of a surface treatment, unless otherwise shown on the plans.

Apply thermoplastic markings to a minimum thickness of 0.060 in. (60 mils). When paint and beads are allowed, apply to a minimum dry thickness of 0.012 in. (12 mils).

Place short-term markings in proper alignment with the location of the final pavement markings. Remove and replace short-term markings not in alignment at the Contractor's expense.

For removable placements, use of RPMs to simulate longitudinal markings is at the Contractor's option. Use side-by-side RPMs to simulate longitudinal lines wider than 4 in. Do not use RPMs for words, symbols, shapes, or diagonal or transverse lines.

- 3.2. **Marking Removal.** Remove markings that conflict with succeeding markings in accordance with Item 677, "Eliminating Existing Pavement Markings and Markers." Remove short-term markings that interfere or conflict with final marking placement immediately before placing final pavement markings, unless otherwise directed. Remove the remainder of the short-term markings before final acceptance.

Remove all temporary markings with minimal damage to the roadway to the satisfaction of the Engineer.

- 3.3. **Performance Requirements.** Ensure all markings are visible from a distance at least 300 ft. in daylight conditions and at least 160 ft. in nighttime conditions when illuminated by automobile low-beam headlights. Determine visibility distances using an automobile traveling on the roadway under dry conditions.

Maintain the markings for 30 calendar days after installation. The end of the 30-day maintenance period does not relieve the Contractor from the performance deficiencies requiring corrective action identified during the 30-day period. Remove and replace markings at the Contractor's expense if they fail to meet the requirements of this Item during the 30-day period. The 30-calendar day performance requirement will begin again after replacement of the markings.

Ensure daytime and nighttime reflected color of the markings are distinctly white or yellow. Ensure markings exhibit uniform retroreflective characteristics.

4. MEASUREMENT

This Item will be measured by the foot or each word, shape, symbol, or temporary flexible reflective roadway marker tab. Each stripe will be measured separately. RPMs used to simulate a marking will be measured by the foot of marking or each RPM.

This is a plans quantity measurement Item. The quantity to be paid is the quantity shown in the proposal, unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Work Zone Pavement Markings" of the type and color specified and the shape, width, and size specified as applicable. This price is full compensation for furnishing, placing, maintaining, and removing work zone pavement markings and for materials, equipment, labor, tools, and incidentals.

Elimination of nonremovable markings will be paid for under Item 677, "Eliminating Existing Pavement Markings and Markers." Removal of short-term and removable markings will not be paid for directly but will be subsidiary to this Item.

Type II work zone pavement markings (paint and beads) used as a sealer for Type I pavement markings (thermoplastic) will be paid for under this Item.

THIS PAGE LEFT INTENTIONALLY BLANK

Item 666

Retroreflectorized Pavement Markings



1. DESCRIPTION

Furnish and place retroreflectorized, non-retroreflectorized (shadow) and profile pavement markings.

2. MATERIALS

2.1. **Type I Marking Materials.** Furnish in accordance with [DMS-8220](#), "Hot Applied Thermoplastic."

Furnish pavement marking material used for Type I profile markings and shadow markings that have been approved by the Construction Division, and in accordance with [DMS-8220](#), "Hot Applied Thermoplastic."

2.2. **Type II Marking Materials.** Furnish in accordance with [DMS-8200](#), "Traffic Paint."

2.3. **Glass Traffic Beads.** Furnish drop-on glass beads in accordance with [DMS-8290](#), "Glass Traffic Beads" or as approved. Furnish a double-drop of Type II and Type III drop-on glass beads where each type bead is applied separately in equal portions (by weight), unless otherwise approved. Apply the Type III beads before applying the Type II beads.

2.4. **Labeling.** Use clearly marked containers that indicate color, mass, material type, manufacturer, and batch number.

3. EQUIPMENT

3.1. **General Requirements.** Use equipment that:

- is maintained in satisfactory condition,
- meets or exceeds the requirements of the National Board of Fire Underwriters and the Texas Railroad Commission for this application,
- applies beads by an automatic bead dispenser attached to the pavement marking equipment in such a manner that the beads are dispensed uniformly and almost instantly upon the marking as the marking is being applied to the road surface. The bead dispenser must have an automatic cut-off control, synchronized with the cut-off of the pavement marking equipment,
- has an automatic cut-off device with manual operating capabilities to provide clean, square marking ends,
- is capable of producing the types and shapes of profiles specified, and
- can provide continuous mixing and agitation of the pavement marking material. The use of pans, aprons, or similar appliances which the die overruns will not be permitted for longitudinal striping applications.

Provide a hand-held thermometer capable of measuring the temperature of the marking material when applying Type I material.

When pavement markings are required to meet minimum retroreflectivity requirements on the plans:

- Use a mobile retroreflectometer approved by the Construction Division and certified by the Texas A&M Transportation Institute Mobile Retroreflectometer Certification Program.
- Use a portable retroreflectometer that:
 - uses 30-meter geometry and meets the requirements described in ASTM E1710;
 - has either an internal global positioning system (GPS) or the ability to be linked with an external GPS with a minimum accuracy rating of 16 ft. 5 in., in accordance with the circular error probability

(CEP) method (CEP is the radius of the circle with its origin at a known position that encompasses 50% of the readings returned from the GPS instrument);

- can record and print the GPS location and retroreflectivity reading for each location where readings are taken.

3.2. **Material Placement Requirements.** Use equipment that can place:

- at least 40,000 ft. of 4-in. solid or broken non-profile markings per working day at the specified thickness;
- at least 15,000 ft. of solid or broken profile pavement markings per working day at the specified thickness;
- linear non-profile markings up to 8 in. wide in a single pass;
- non-profile pavement markings other than solid or broken lines at an approved production rate;
- a centerline and no-passing barrier-line configuration consisting of 1 broken line and 2 solid lines at the same time to the alignment, spacing, and thickness for non-profile pavement markings shown on the plans;
- solid and broken lines simultaneously;
- white line from both sides;
- lines with clean edges, uniform cross-section with a tolerance of $\pm 1/8$ in. per 4 in. width, uniform thickness, and reasonably square ends;
- skip lines between 10 and 10-1/2 ft., a stripe-to-gap ratio of 10 to 30, and a stripe-gap cycle between 39-1/2 ft. and 40-1/2 ft., automatically;
- beads uniformly and almost instantly on the marking as the marking is being applied;
- beads uniformly during the application of all lines (each line must have an equivalent bead yield rate and embedment); and
- double-drop bead applications using both Type II and Type III beads from separate independent bead applicators, unless otherwise approved by the Engineer.

4. CONSTRUCTION

Place markings before opening to traffic unless short-term or work zone markings are allowed.

4.1. **General.** Obtain approval for the sequence of work and estimated daily production. Minimize interference to roadway operations when placing markings on roadways open to traffic. Use traffic control as shown on the plans or as approved. Protect all markings placed under open-traffic conditions from traffic damage and disfigurement.

Establish guides to mark the lateral location of pavement markings as shown on the plans or as directed, and have guide locations verified. Use material for guides that will not leave a permanent mark on the roadway.

Apply markings on pavement that is completely dry and passes the following tests:

- Type I Marking Application—Place a sample of Type I marking material on a piece of tarpaper placed on the pavement. Allow the material to cool to ambient temperature, and then inspect the underside of the tarpaper in contact with the pavement. Pavement will be considered dry if there is no condensation on the tarpaper.
- Type II Marking Application—Place a 1-sq. ft. piece of clear plastic on the pavement, and weight down the edges. The pavement is considered dry if, when inspected after 15 min., no condensation has occurred on the underside of the plastic.

Apply markings:

- that meet the requirements of [Tex-828-B](#).

- that meet minimum retroreflectivity requirements when specified on the plans (applies to Type I markings only),
- using widths and colors shown on the plans,
- at locations shown on the plans,
- in proper alignment with the guides without deviating from the alignment more than 1 in. per 200 ft. of roadway or more than 2 in. maximum,
- without abrupt deviations,
- free of blisters and with no more than 5% by area of holes or voids,
- with uniform cross-section, density and thickness,
- with clean and reasonably square ends,
- that are retroreflectorized with drop-on glass beads, and
- using personnel skilled and experienced with installation of pavement markings.

Remove all applied markings that are not in alignment or sequence as stated on the plans, or in the specifications, at the Contractor's expense in accordance with Item 677, "Eliminating Existing Pavement Markings and Markers," except for measurement and payment.

- 4.2. **Surface Preparation.** Prepare surfaces in accordance with this Section unless otherwise shown on the plans.
- 4.2.1. **Cleaning for New Asphalt Surfaces and Retracing of All Surfaces.** Air blast or broom the pavement surface for new asphalt surfaces (less than 3 years old) and for retracing of all surfaces to remove loose material, unless otherwise shown on the plans. A sealer for Type I markings is not required unless otherwise shown on the plans.
- 4.2.2. **Cleaning for Old Asphalt and Concrete Surfaces (Excludes Retracing).** Clean old asphalt surfaces (more than 3 years old) and all concrete surfaces in accordance with Item 678, "Pavement Surface Preparation for Markings," to remove curing membrane, dirt, grease, loose and flaking existing construction markings, and other forms of contamination.
- 4.2.3. **Sealer for Type I Markings.** Apply a pavement sealer to old asphalt surfaces (more than 3 years old) and to all concrete surfaces before placing Type I markings on locations that do not have existing markings, unless otherwise approved. The pavement sealer may be either a Type II marking or an acrylic or epoxy sealer as recommended by the Type I marking manufacturer unless otherwise shown on the plans. Follow the manufacturer's directions for application of acrylic or epoxy sealers. Clean sealer that becomes dirty after placement by washing or in accordance with Section 666.4.2.1., "Cleaning for New Asphalt Surfaces and Retracing of All Surfaces," as directed. Place the sealer in the same configuration and color (unless clear) as the Type I markings unless otherwise shown on the plans.
- 4.3. **Application.** Apply markings during good weather unless otherwise directed. If markings are placed at Contractor option when inclement weather is impending and the markings are damaged by subsequent precipitation, the Contractor is responsible for all required replacement costs.
- 4.3.1. **Type I Markings.** Place the Type I marking after the sealer cures. Apply within the temperature limits recommended by the material manufacturer. Flush the spray head if spray application operations cease for 5 min or longer by spraying marking material into a pan or similar container until the material being applied is at the recommended temperature.
- Apply on clean, dry pavements passing the moisture test described in Section 666.4.1., "General," and with a surface temperature above 50°F when measured in accordance with [Tex-829-B](#).
- 4.3.1.1. **Non-Profile Pavement Markings.** Apply Type I non-profile markings with a minimum thickness of:
- 0.100 in. (100 mils) for new markings and retracing water-based markings on surface treatments involving Item 316, "Seal Coat,"

- 0.060 in. (60 mils) for retracing on thermoplastic pavement markings, or
- 0.090 in. (90 mils) for all other Type I markings.

The maximum thickness for Type I non-profile markings is 0.180 in. (180 mils). Measure thickness for markings in accordance with [Tex-854-B](#) using the tape method.

4.3.1.2. **Profile Pavement Markings.** Apply Type I profile markings with a minimum thickness of:

- 0.060 in. (60 mil) for edgeline markings, or
- 0.090 in. (90 mil) for gore and centerline/no-passing barrier line markings.

In addition, at a longitudinal spacing indicated on the plans, the markings must be profiled in a vertical manner such that the profile is transverse to the longitudinal marking direction. The profile must not be less than 0.30 in. (300 mil) nor greater than 0.50 in. (500 mil) in height when measured above the normal top surface plane of the roadway. The transverse width of the profile must not be less than 3.25 in., and the longitudinal width not less than 1 in., when measured at the top surface plane of the profile bar. The profile may be either a 1 or 2 transverse bar profile. When the 2 transverse bar profile is used, the spacing between the bases of the profile bars must not exceed 0.50 in. The above transverse bar width is for each 4 in. of line width.

4.3.2. **Type II Markings.** Apply on surfaces with a minimum surface temperature of 50°F. Apply at least 20 gal. per mile on concrete and asphalt surfaces and at least 22 gal. per mile on surface treatments for a solid 4-in. line. Adjust application rates proportionally for other widths. When Type II markings are used as a sealer for Type I markings, apply at least 15 gal. per mile using Type II drop-on beads.

4.3.3. **Bead Coverage.** Provide a uniform distribution of beads across the surface of the stripe for Type I and Type II markings, with 40% to 60% bead embedment.

4.4. **Retroreflectivity Requirements.** When specified on the plans, Type I markings must meet the following minimum retroreflectivity values for edgeline markings, centerline or no passing barrier-line, and lane lines when measured any time after 3 days, but not later than 10 days after application:

- White markings: 250 millicandelas per square meter per lux (mcd/m²/lx)
- Yellow markings: 175 mcd/m²/lx

4.5. **Retroreflectivity Measurements.** Use a mobile retroreflectometer for projects requiring minimum retroreflectivity requirements to measure retroreflectivity for Contracts totaling more than 200,000 ft. of pavement markings, unless otherwise shown on the plans. For Contracts with less than 200,000 ft. of pavement markings or Contracts with callout work, mobile or portable retroreflectometers may be used at the Contractor's discretion.

4.5.1. **Mobile Retroreflectometer Measurements.** Provide mobile measurements averages for every 0.1 miles unless otherwise specified or approved. Take measurements on each section of roadway for each series of markings (i.e., edgeline, center skip line, each line of a double line, etc.) and for each direction of traffic flow. Measure each line in both directions for centerlines on two-way roadways (i.e., measure both double solid lines in both directions and measure all center skip lines in both directions). Furnish measurements in compliance with Special Specification, "Mobile Retroreflectivity Data Collection for Pavement Markings," unless otherwise approved. The Engineer may require an occasional field comparison check with a portable retroreflectometer meeting the requirements listed above to ensure accuracy. Use all equipment in accordance with the manufacturer's recommendations and directions. Inform the Engineer at least 24 hr. before taking any measurements.

A marking meets the retroreflectivity requirements if:

- the combined average retroreflectivity measurement for a one-mile segment meets the minimum retroreflectivity values specified, and
- no more than 30% of the retroreflectivity measurement values are below the minimum retroreflectivity requirements value within the one-mile segment.

The Engineer may accept failing one-mile segments if no more than 20% of the retroreflectivity measurements within that mile segment are below the minimum retroreflectivity requirement value.

The one-mile segment will start from the beginning of the data collection and end after a mile worth of measurements have been taken; each subsequent mile of measurements will be a new segment. Centerlines with 2 stripes (either solid or broken) will result in 2 miles of data for each mile segment. Each centerline stripe must be tested for compliance as a stand-alone stripe.

Restripe at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking if the marking fails retroreflectivity requirements. Take measurements every 0.1 miles a minimum of 10 days after this second application within that mile segment for that series of markings.

If the markings do not meet minimum retroreflectivity after 10 days of this second application, the Engineer may require removal of all existing markings, a new application as initially specified, and a repeat of the application process until minimum retroreflectivity requirements are met.

- 4.5.2. **Portable Retroreflectometer Measurements.** Take a minimum of 20 measurements for each 1-mi. section of roadway for each series of markings (i.e., edgeline, center skip line, each line of a double line, etc.) and direction of traffic flow when using a portable reflectometer. Measure each line in both directions for centerlines on two-way roadways (i.e., measure both double solid lines in both directions and measure all center skip lines in both directions). The spacing between each measurement must be at least 100 ft. The Engineer may decrease the mileage frequency for measurements if the previous measurements provide satisfactory results. The Engineer may require the original number of measurements if concerns arise.

Restripe once at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking material if the average of these measurements fails. Take a minimum of 10 more measurements after 10 days of this second application within that mile segment for that series of markings. Restripe again at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking material if the average of these measurements fall below the minimum retroreflectivity requirements. If the markings do not meet minimum retroreflectivity after this third application, the Engineer may require removal of all existing markings, a new application as initially specified, and a repeat of the application process until minimum retroreflectivity requirements are met.

- 4.5.3. **Traffic Control.** Provide traffic control, as required, when taking retroreflectivity measurements after marking application. On low volume roadways (as defined on the plans), refer to the figure, "Temporary Road Closure" in Part 6 of the *Texas Manual on Uniform Traffic Control Devices* for the minimum traffic control requirements. For all other roadways, the minimum traffic control requirements will be as shown on the Traffic Control Plan (TCP) standard sheets TCP (3-1) and TCP (3-2). The lead vehicle will not be required on divided highways. The TCP and traffic control devices must meet the requirements listed in Item 502, "Barricades, Signs, and Traffic Handling." Time restrictions that apply during striping application will also apply during the retroreflectivity inspections except when using the mobile retroreflectometer unless otherwise shown on the plans or approved.

- 4.6. **Performance Period.** All markings must meet the requirements of this specification for at least 30 calendar days after installation. Unless otherwise directed, remove pavement markings that fail to meet requirements, and replace at the Contractor's expense. Replace failing markings within 30 days of notification. All replacement markings must also meet all requirements of this Item for a minimum of 30 calendar days after installation.

5. MEASUREMENT

This Item will be measured by the foot; by each word, symbol, or shape; or by any other unit shown on the plans. Each stripe will be measured separately.

This is a plans quantity measurement item. The quantity to be paid is the quantity shown in the proposal unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

Acrylic or epoxy sealer, or Type II markings when used as a sealer for Type I markings, will be measured by the foot; by each word, symbol, or shape; or by any other unit shown on the plans.

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Pavement Sealer" of the size specified, "Retroreflectorized Pavement Markings" of the type and color specified and the shape, width, size, and thickness specified as applicable, "Retroreflectorized Pavement Markings with Retroreflective Requirements" of the types, colors, sizes, widths, and thicknesses specified or "Retroreflectorized Profile Pavement Markings" of the various types, colors, shapes, sizes, and widths specified.

This price is full compensation for application of pavement markings, materials, equipment, labor, tools, and incidentals.

Surface preparation of new concrete and asphalt concrete pavements more than 3 years old, where no stripe exists, will be paid for under Item 678, "Pavement Surface Preparation for Markings." Surface preparation of all other asphalt and old concrete pavement, except for sealing, will not be paid for directly but is subsidiary to this Item.

Work zone pavement markings (Type II, paint and beads) used as a sealer for Type I markings (thermoplastic) will be paid for under Item 662, "Work Zone Pavement Markings."

If the Engineer requires that markings be placed in inclement weather, repair or replacement of markings damaged by the inclement weather will be paid for in addition to the original plans quantity.

Item 678

Pavement Surface Preparation for Markings



1. DESCRIPTION

Prepare pavement surface areas before placement of pavement markings and raised pavement markers (RPMs). Item 677, "Eliminating Existing Pavement Markings and Markers," governs removal of existing markings.

2. MATERIALS

Use a commercial abrasive blasting medium capable of producing the specified surface cleanliness. Use potable water, when water is required.

3. EQUIPMENT

Furnish and maintain equipment in good working condition. Use moisture and oil traps in air compression equipment to remove all contaminants from the blasting air and prevent the deposition of moisture, oil, or other contaminants on the roadway surface.

4. CONSTRUCTION

Prepare enough pavement surface for the pavement markings or RPMs shown on the plans. Remove all contamination and loose material. Avoid damaging the pavement surface. Remove loose and flaking material when existing pavement markings are present. Approved pavement surface preparation methods are sweeping, air blasting, flail milling, and blast cleaning unless otherwise specified on the plans.

Air blast concrete pavement surfaces, in addition to the above, after the removal of contamination or existing material and just before placing the stripe. Perform air blasting with a compressor capable of generating compressed air at a minimum of 150 cu. ft. per minute and 100 psi using 5/16 in. or larger hosing.

Contaminants up to 0.5 sq. in. may remain if they are not removed by the following test, performed just before application of markings:

- **Step 1.** Air blast the surface to be tested, to simulate blasting during application of markings.
- **Step 2.** Firmly press a 10-in. long, 2-in. wide strip of monofilament tape onto the surface, leaving approximately 2 in. free.
- **Step 3.** Grasp the free end and remove the tape with a sharp pull.

5. MEASUREMENT

This Item will be measured by the foot for each width specified; by each word, shape, or symbol; or by any other unit except lump sum.

This is a plans quantity measurement Item. The quantity to be paid is the quantity shown in the proposal, unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

6.

PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Pavement Surface Preparation for Markings" of the type and width as applicable. This price is full compensation for the cleaning method used, materials, equipment, labor, tools, and incidentals.

Item 735

Debris Removal



1. DESCRIPTION

Remove and dispose of debris discarded or deposited on or adjacent to the pavement. Debris includes all objects not part of the highway facility, such as dead animals, tires, tire fragments, wood, furniture, mattresses, household appliances, and scrap metal.

2. EQUIPMENT

Provide highly visible omni-directional flashing warning lights on work vehicles. Provide equipment that prevents the accumulated debris from being strewn along the roadway during transport.

3. WORK METHODS

Remove debris at locations shown on the plans. Notify the Department for removal of hazardous materials. Dispose of debris off the right of way in accordance with applicable federal, state, and local regulations.

3.1. **Center Medians and Mainlanes.** Remove and dispose of debris from the main travel lanes, paved medians, paved shoulders, and an additional 5 ft. adjacent to the pavement, unless otherwise shown on the plans.

3.2. **Frontage Roads.** Remove and dispose of debris from frontage roads, shoulders, U-turn lanes, and intersecting streets to the right of way, including turn lanes, underpasses and overpasses, and an additional 5 ft. adjacent to the pavement, unless otherwise shown on the plans.

3.3. **Entrance and Exit Ramps.** Remove and dispose of debris from ramps, shoulders, and an additional 5 ft. adjacent to the pavement, unless otherwise shown on the plans.

3.4. **High Occupancy Vehicle (HOV) Lane.** Remove and dispose of debris from HOV lanes including HOV ramps. The HOV lanes are defined as:

3.4.1. **Barrier-Separated Contraflow Lane.** Barrier-separated contraflow lane(s) is defined as a lane enclosed by two physical barriers.

3.4.2. **Buffer-Separated Concurrent Flow Lane.** Buffer-separated concurrent flow lane is separated from general purpose lanes by a striped buffer zone and is defined as the left or inner most lane identified by signing and diamond symbols on the pavement.

3.5. **Direct Connector Ramp Debris Removal.** Remove and dispose of debris from the shoulders and paved gutters of direct connector ramp.

3.6. **Spot Debris Removal.** Work requests are made on a callout basis. Remove and dispose of debris as directed. Begin removing debris within 3 hr. of notification, unless otherwise shown on the plans.

4. MEASUREMENT

This Item will be measured as follows:

- 4.1. **Center Medians and Mainlanes, Frontage Roads, and Entrance and Exit Ramps.** By the cycle or right of way centerline mile. A right of way centerline mile is defined as the distance from beginning reference marker location to ending reference marker location, regardless of the number of roadbeds.
- 4.2. **HOV Lane Debris Removal.** By the cycle or HOV lane centerline miles. HOV lane centerline mile is defined as the distance measured along each HOV lane regardless of the number of lanes.
- 4.3. **Direct Connector Ramp Debris Removal.** By the cycle or direct connector ramp centerline mile. A direct connector centerline mile is defined as the distance measured along each direct connector regardless of the number of lanes.
- 4.4. **Spot Debris Removal.** By the roadbed mile. The minimum quantity per callout is 1 roadbed mile, unless otherwise shown on the plans.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit prices bid for "Debris Removal" of the type and cycle location specified. This price is full compensation for collecting, hauling and disposing of debris, and for equipment, labor, materials, tools, and incidentals. Traffic control will not be paid for directly but will be subsidiary to this Item, unless otherwise shown on the plans.

Debris removal in buffer-separated concurrent flow lanes is considered subsidiary to debris removal in center medians and mainlanes, unless otherwise shown on the plans.

Debris removal required for work orders issued under Item 734, "Litter Removal," or Item 738, "Cleaning and Sweeping Highways," will be subsidiary to that Item unless otherwise shown on the plans.

Item 738

Cleaning and Sweeping Highways



1. DESCRIPTION

Clean and sweep highway facilities.

2. EQUIPMENT

Furnish equipment and tools capable of dislodging crusted debris from road surfaces, removing and collecting materials from roadway. Provide highly visible omni-directional flashing warning lights on work vehicles. Furnish equipment with a water tank and adequate spray assemblies for dust control, and a dirt hopper with enough capacity to allow progress with minimum interference to traffic. Provide other types of cleaning and sweeping equipment, including hand tools, when required.

3. WORK METHODS

Completely remove debris from pavement surfaces and other areas designated on the plans, such as all sides of raised pavement markers, barrier drain slots, slotted drains, inlet openings, attenuators, and guardrails. Notify the Department for removal of hazardous materials. Debris is defined as dirt and other objects not part of the highway facility including dead animals, tires, tire fragments, wood, furniture, mattresses, household appliances, and scrap metal. Collect the debris and dispose of it off the right of way in accordance with federal, state, and local regulations. Ensure debris is not swept or blown onto traffic lanes. The types of cleaning and sweeping are as follows:

- 3.1. **Center Median Cleaning and Sweeping.** Clean and sweep the paved center medians or left-paved shoulders and left-paved gutters.
- 3.2. **Outside Mainlane Cleaning and Sweeping.** Clean and sweep the outside lanes or right-paved shoulders and right paved gutters. Clean and sweep intersecting streets to the right of way line.
- 3.3. **Frontage Road Cleaning and Sweeping.** Clean and sweep the right- and left-paved shoulders and paved gutters on all frontage roads. Clean and sweep U-turn lanes and intersecting streets to the right of way line, including turn lanes, underpasses, and overpasses.
- 3.4. **Entrance and Exit Ramp Cleaning and Sweeping.** Clean and sweep right- and left-paved shoulders and paved gutters of ramps.
- 3.5. **Direct Connector Cleaning and Sweeping.** Clean and sweep the right and left paved shoulders and paved gutters of direct connectors.
- 3.6. **HOV Lane Cleaning and Sweeping.** Clean and sweep HOV lanes, bridges and ramps.
- 3.7. **Aggregate Removal.** Clean and remove aggregate from designated areas following adverse weather conditions.
- 3.8. **Spot Sweeping.** Work requests are made on a callout basis. Clean and sweep roadways in designated areas. Begin sweeping within 3 hr. of notification, unless otherwise shown on the plans.
- 3.9. **Handwork.** Clean and sweep areas as shown on the plans or as directed.

4. MEASUREMENT

Right of way centerline mile is defined as the distance measured from the beginning point to the ending point shown on the plans and is measured once regardless of the number of lanes or roadbeds.

Ramp centerline mile is defined as the distance measured along each ramp regardless of the number of lanes. A roadbed mile is defined as the distance along each roadbed regardless of the number of lanes.

HOV lane centerline mile is defined as the distance measured along each HOV lane regardless of the number of lanes. A direct connector centerline mile is defined as the distance measured along each direct connector regardless of the number of lanes.

Types of cleaning and sweeping will be measured as follows:

- 4.1. **Center Median.** By the cycle or right of way centerline mile.
- 4.2. **Outside Mainlane.** By the cycle or right of way centerline mile.
- 4.3. **Frontage Road.** By the cycle or right of way centerline mile.
- 4.4. **Entrance and Exit Ramp.** By the cycle or ramp centerline mile.
- 4.5. **HOV Lane Cleaning and Sweeping.** By the cycle or HOV lane centerline mile.
- 4.6. **Direct Connector Cleaning and Sweeping.** By the cycle or direct connector centerline mile.
- 4.7. **Aggregate Removal.** By the roadbed mile.
- 4.8. **Spot.** By the roadbed mile. The minimum quantity per callout is 1 roadbed mile, unless otherwise shown on the plans.
- 4.9. **Handwork.** By the square yard.

5. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Cleaning and Sweeping" of the type and cycle location specified. This price is full compensation for cleaning, sweeping, collecting, hauling and disposing of debris, and for equipment, labor, materials, tools, and incidentals.

When work requests include multiple bid items and overlap occurs, the measurement and payment priority will be determined by the order shown in "Measurement."

Cleaning of items such as raised pavement markers, barrier drain slots, slotted drains, inlet openings, and areas adjacent to attenuator and guardrail supports will not be paid for directly but will be subsidiary to this Item unless otherwise shown on the plans.